

Mansoura Engineering Journal

Volume 16 | Issue 1

Article 6

5-1-2021

Modeling and Simulation for Multivariable Chemical System in Semadco Urea-Plant.

K. Soliman

Automatic Control & Computers Department., Faculty of Engineering., El- Mansoura University., Mansoura., Egypt.

N. Mekkawy

Process control & Inst. Dept., Ammonia plant., Semadco, Talkha.

Follow this and additional works at: <https://mej.researchcommons.org/home>

Recommended Citation

Soliman, K. and Mekkawy, N. (2021) "Modeling and Simulation for Multivariable Chemical System in Semadco Urea-Plant." *Mansoura Engineering Journal*: Vol. 16 : Iss. 1 , Article 6.
Available at: <https://doi.org/10.21608/bfemu.2021.169278>

This Original Study is brought to you for free and open access by Mansoura Engineering Journal. It has been accepted for inclusion in Mansoura Engineering Journal by an authorized editor of Mansoura Engineering Journal. For more information, please contact mej@mans.edu.eg.

**Modeling and Simulation for multivariable
Chemical System in Semadco Urea-Plant**

**استبيان سموذج رياضي لنظام كيميائي متعدد المعاير
بوحدة الوريا بمصنع سماد طلفا**

K. H. Soliman

Aut. Control & Computers Dept., Faculty of Eng., Mansoura University.

N. Mekkawy

Process control & Inst. Dept., Ammonia plant, Semadco, TALKHA.

لتحقيق هدف السيطرة والاحزان على ظروف التشغيل لوحدة محول الامونيا (R-107) بمصنع سماد طلفا، وذلك عن طريق تصميم جهاز تحكم مناسب لى درجة حرارة الغاز الخارج من مفن الفغط (HP - BFW- E-127) عن طريق قبط كمية ماء تغذية الغلاية ، يتلزم تكوين سموذج رياضي دقيق يمكن عن طريقه التمثيل المصحح لتركيب وتشغيل الوحدة .

ومن أجل عدم توافر مثل هذا النموذج الرياضي بالمراتج العلمية المختلفة أو بالوثائق العلمية الخاصة بالعنصر ، لهذا اهتم البحث بتحكيم واستبيان هذا النموذج استنادا الى البيانات العملية المستناده من ظروف تشغيل الوحدة وذلك باتباع اسلوب تقليم الوحدة المركبة السعة وحدات منفصلة تحر اربط فيما بينها بالتمثيل الرياضي المناسب .

وقد تم اختبار هذا النموذج المكتسب عن طريق ملاربة النتائج النظرية للحسابات الرياضية المستندة عليه مع القراءات الفعلية بالمجلة من ظروف التشغيل الفعلى للوحدة . ولقد اشارت هذه الممارس الى انطابق هذا النموذج المكتسب الى حد كبير مع ظروف التشغيل المجلة بما يؤيد ملائمة هذا النموذج للاستخدام فيما بعد لتصميم نظام تحكم جيد للوحدة .

Abstract:

For target of stabilizing the operation of ammonia converter R-107 is Semadco (TALKHA II Fertilizer Company); that is by designing appropriate control system for the "HP BFW heater E-127" (High Pressure Boiler Feed Water heater) which governs the system inlet temperature; it is very important to construct a mathematical model which simulates perfectly the practical system construction and operation.

Such a model is not clearly and accurately presented in references. So; this work deals with formulating and constructing suitable mathematical model for this E -127 heater. The modeling procedure is based on dividing the chemical system into subsystems coupled through boundary conditions.

The suggested mathematical model is tested numerically by computing the system open loop performances, which are then compared with the recorded experimental performances from the field.

The results obtained show good agreement between both of the suggested model and the physical system.

Introduction :

In the ammonia synthesis section of Semadco urea plant shown in Fig.(1); the primary objective in the control of a high-pressure synthesis loop, and the entire ammonia plant is to produce the desired amount of product consistency ;(1200 metric tons per day); with low operating costs, minimum risk, long equipment life time and reduced down time. An optimization of the operation of the synthesis loop requires that careful attention be given to operating variables; the most important of which are: [1,8]

- 1-converter temperature.
- 2-loop pressure.
- 3-inert concentration inlet converter.
- 4-H₂ / N₂ ratio.
- 5-gas circulation rate.

The main reaction in the ammonia converter R-107 is a highly exothermic one. Consequently, the hot reactor effluent is often used to preheat the reactor feeding from 30°C to 150°C through the ammonia converter feed effluent exchanger E-128, such exchange may lead to serious stability problems in the reactor operation due to undesirable operating conditions.

As shown in fig.(2-a), the relation between the reactor feeding temperature (T_f) and the reactor effluent temperature (T_r) follows a sigmoidal curve. In other way, a heat balance around the heat exchanger operating point is represented by a straight line linear relation.

Mostly, the unstable problems associated with the reactor operation are occurred due to the operating point "S" [3]. Thus, a secondary heater E-127 with BFW is added which can be designed with the aid of robust adaptive controller in purpose of modifying the sigmoidal curve to that suggested in Fig.(2-b).

This E-127 heater can give heat duty of 30.5×10^4 kcal/hr. [8] during passing the hot effluent gases from ammonia converter R-107 at 327° where the gas is cooled to 189°C.

Precisely constructed mathematical model for E-127 heater is helpful for designing appropriate controller. Such a model is not available ; so, this work deals with building a suitable one; that is by considering the heater as a multivariable system, and depending on the practical knowledge and observations of the process feeds and parameters.

Model Building for the HP BFW heater E-127

Considering the E-127 subsystem under study shown in Fig.(3) with associated chosen input and output variables which can be defined as:

u_1 : stroke of valve HV111.

u_2 : stroke of valve FVS1.

D : input temperature to E-127 (TI0164).

y_1 : BFW flow (FTS7) + interaction effect from (FTS1).

y_2 : flow to E-127 (FTS1) + interaction effect from (FTS7).

y_3 : output temperature (TI0153).

and selecting the state variables as:

x_1 : BFW flow (FTS7).

x_2 : flow to E-127 (FTS1).

x_3 : output temperature (TI0153).

$$x_4: \text{gas circulation rate } Q = \frac{54.64 \text{ A}}{T_r - T_f} * \text{TRF} \quad (4,5)$$

where A is the ammonia product in tons/day.

TRF is the temperature rise factor.

The system can be represented by the suggested block diagram shown in Fig.(4); for which system transfer functions can be performed in the following matrix equation form : [2,6]

$$\begin{bmatrix} y_1 \\ y_2 \\ y_3 \end{bmatrix} = \begin{bmatrix} G_{v1} & (G_{v2} \cdot G_{p12}) \\ (G_{v1} \cdot G_{p21}) & G_{v2} \\ (G_{v1} \cdot G_{p21}) & (G_{v2} \cdot G_{p32}) \end{bmatrix} \begin{bmatrix} u_1 \\ u_2 \end{bmatrix} + \begin{bmatrix} 0 \\ 0 \\ G_{pas} \end{bmatrix} \begin{bmatrix} D \end{bmatrix} \quad (1)$$

with the system output equations :

$$\begin{bmatrix} y_1 \\ y_2 \\ y_3 \end{bmatrix} = \begin{bmatrix} 1 & c k_1 & 0 & 0 \\ c k_2 & 1 & 0 & 0 \\ 0 & 0 & 1 & 0 \end{bmatrix} \begin{bmatrix} x_1 \\ x_2 \\ x_3 \\ x_4 \end{bmatrix} \quad (2)$$

where: [6,7]

$$G_{v1} = \frac{TK_1}{TV_1 S + 1} \quad G_{v2} = \frac{TK_2}{TV_2 S + 1}$$

$$G_{p12} = c k_1 \quad G_{p21} = c k_2$$

$$G_{p31} = \frac{c k_3}{TT_1 S + 1} \quad G_{p32} = \frac{c k_4}{TT_2 S + 1}$$

$$G_{pas} = \frac{c k_5}{TT_3 S + 1}$$

Thus, system state model can be deduced from (1) & (2) giving

$$\begin{bmatrix} \dot{x}_1 \\ \dot{x}_2 \\ \dot{x}_3 \\ \dot{x}_4 \end{bmatrix} = \begin{bmatrix} a_{11} & 0 & 0 & 0 \\ 0 & a_{22} & 0 & 0 \\ 0 & 0 & a_{33} & a_{34} \\ a_{41} & a_{42} & a_{43} & a_{44} \end{bmatrix} \begin{bmatrix} x_1 \\ x_2 \\ x_3 \\ x_4 \end{bmatrix} + \begin{bmatrix} b_{11} & 0 \\ 0 & b_{22} \\ 0 & 0 \\ b_{41} & b_{42} \end{bmatrix} \begin{bmatrix} u_1 \\ u_2 \end{bmatrix} + \begin{bmatrix} 0 \\ 0 \\ \gamma_s \\ 0 \end{bmatrix} [D] \quad (3)$$

where all of a , b and γ parameters depend on the previous defined system constants by complicated relations which are omitted here for saving area. These parameters will be identified in the next section by the aid of experimental investigations.

Parameters Calculations and Results:

Experimental approach is used to investigate how the behavior of HP BFW heater E-127 changes with time under the influence of changing external disturbances and manipulated variables. Table (1) summarizes the recorded changes in the E-127 outputs under deliberately 1% step change in the FV51 valve stroke (u_2).

From these data, system specification parameters can be calculated giving final values as shown in table(2) .

Consequently; the different transfer function components will be:

$$\begin{aligned} G_{v1} &= \frac{1.8}{0.06 S+1} & G_{v2} &= \frac{0.825}{0.06 S+1} \\ G_{p12} &= Ck_1 = 0.0 \\ &\quad -0.23 & G_{p21} &= Ck_2 = 0.3 \\ G_{p11} &= \frac{10 S + 1}{8} & G_{p22} &= \frac{-0.155}{10 S + 1} \\ G_{p33} &= \frac{1}{10 S + 1} \end{aligned}$$

and the final state model with the corresponding output equations will be:

$$\begin{bmatrix} \dot{x}_1 \\ \dot{x}_2 \\ \dot{x}_3 \\ \dot{x}_4 \end{bmatrix} = \begin{bmatrix} -16.7 & 0 & 0 & 0 \\ 0 & -16.7 & 0 & 0 \\ 0 & 0 & -0.1 & -1 \\ -0.385 & -0.257 & -0.01 & -0.2 \end{bmatrix} +$$

$$\begin{bmatrix} 0.0 \\ 0 \\ 0 \\ -0.0 \end{bmatrix} \begin{bmatrix} u_1 \\ u_2 \end{bmatrix} + \begin{bmatrix} 0.0 \\ 0.0 \\ 0.8 \\ 0.0 \end{bmatrix} \begin{bmatrix} D \end{bmatrix} \quad (4)$$

$$\begin{bmatrix} y_1 \\ y_2 \\ y_3 \end{bmatrix} = \begin{bmatrix} 1 & 0 & 0 & 0 \\ 0.3 & 1 & 0 & 0 \\ 0 & 0 & 1 & 0 \end{bmatrix} \begin{bmatrix} x_1 \\ x_2 \\ x_3 \\ x_4 \end{bmatrix} \quad (5)$$

According to this deduced mathematical model; and considering nominal values of $u_1 = 0.35$; $u_2 = 0.8$ and $D = 0.874$, transient response calculations are carried out on IBM Personal Computer using Runge-Kutta technique. Calculated state variables are plotted together with that recorded in Fig.(5).

Conclusion:

It is clear from these simulation that x_1 , x_2 , x_4 agree well with recorded values. However, x_3 inspite of tuning parameter values for this variable, the result is not satisfactory. For the time being, the result is stated as it, however more work on this point is undergoing.

Partially satisfactory results are obtained which indicate enough and acceptable similarity between each of experimentally recorded, and the theoretically calculated state changes for the HP-BFW heater (E-127) in the ammonia plant of semadco.

Thus the suggested mathematical model can be considered suitable for simulating the real system after some further adjustment, and consequently helpful when used in future for designing appropriate controllers for governing and modifying operation.

Time (hr)	FT57(y1) m ³ /hr	FT51(y2) m ³ /hr	TI0153(y3) °C	TI0164(D) °C	TI0151(Tf) °C	Q(X ₄) m ³ /hr
0	182	92	195	341	173	6603.00
1	175	110	206	351	165	5964.00
2	170	110	195	350	162	5900.62
3	168	110	192	345	163	6095.14
4	168	110	192	345	163	6095.14
5	168	110	192	345	163	6095.14
6	168	110	191	345	162	6061.84
7	168	110	189	345	160	5996.30
8	168	110	189	345	161	6061.84

* Calculated values according to corresponding mentioned equation

Table (1)

Parameter	value	parameter	value
TK1	1.8 Kg/min	CK5	8.5
TK2	0.825 Kg/min	TV1	0.06 min
CK1	0.0	TV2	0.06 min
CK2	0.3	TT1	10.0 min
CK3	-0.23	TT2	10.0 min
CK4	-0.155	TT3	10.0 min

Table (2)

References:

- 1 -A.V.Slack & G.Russell James "Fertilizer Science and Technology Series-Ammonia part 111" Marcel Dekker INC., 1977.
- 2 -Carlos A.Smith & Armando B.Corripo, "Principle and practice & automatic process control". John wiley & Sons, 1985.
- 3 -George Stephanopoulos, "Chemical process control" PHI, INC.1984.
- 4 -ICI report, 1983 "Semadco ammonia loop problem".
- 5 -ICI report, 19B9 "Ammonia converter specifications".
- 6 -I.J.Nagrath & M.gopal "control systems engineering" 1982.
- 7 -K.H.FASOL and HP.JORGL "Principles of model Building and identification" autcmatica 16, 1980.
- 8 - "General contract specifications, semadoo, Taikha II," Foster wheller Haliana, 1977.

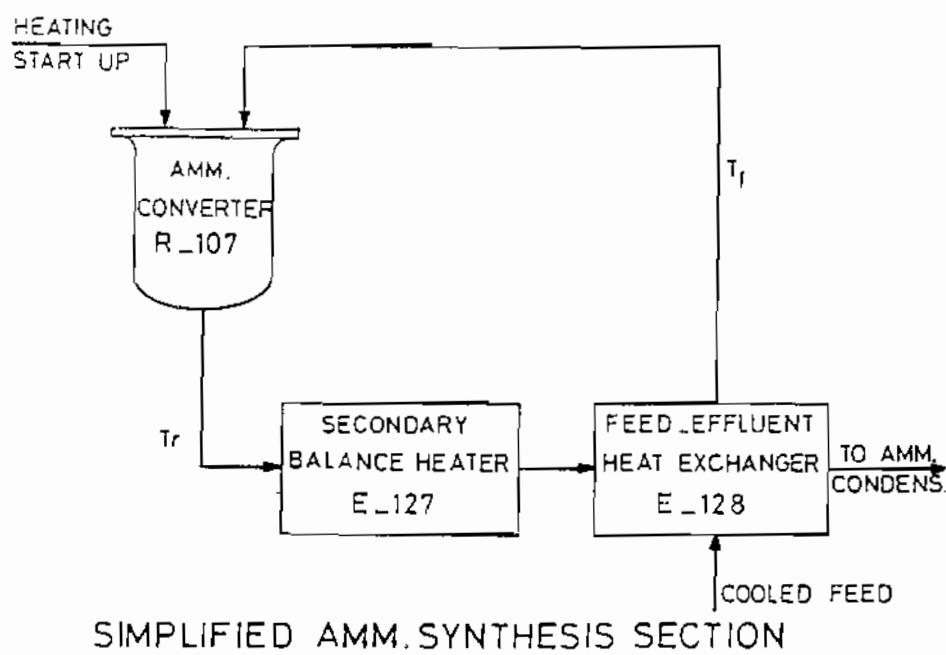
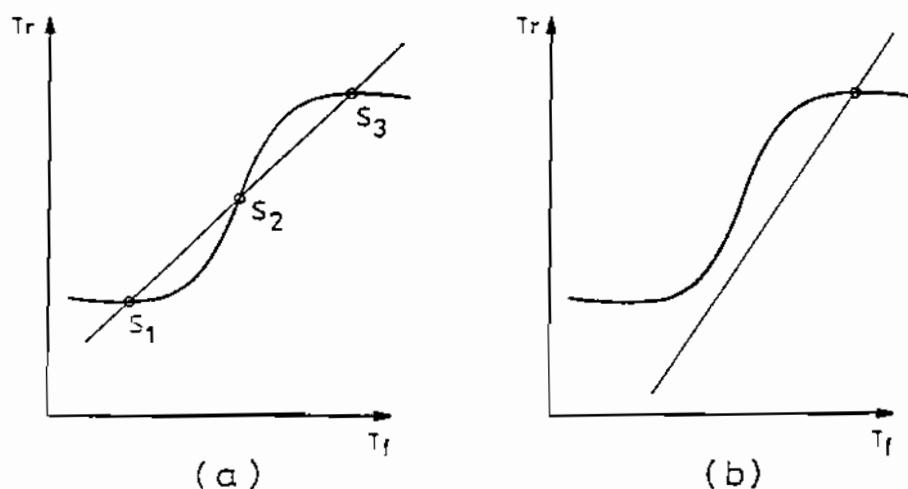


FIG. (1)

REACTOR HEAT BALANCE :-

- (a) WITHOUT SECONDARY BALANCE HEATER .
- (b) WITH SECONDARY BALANCE HEATER .

FIG. (2)

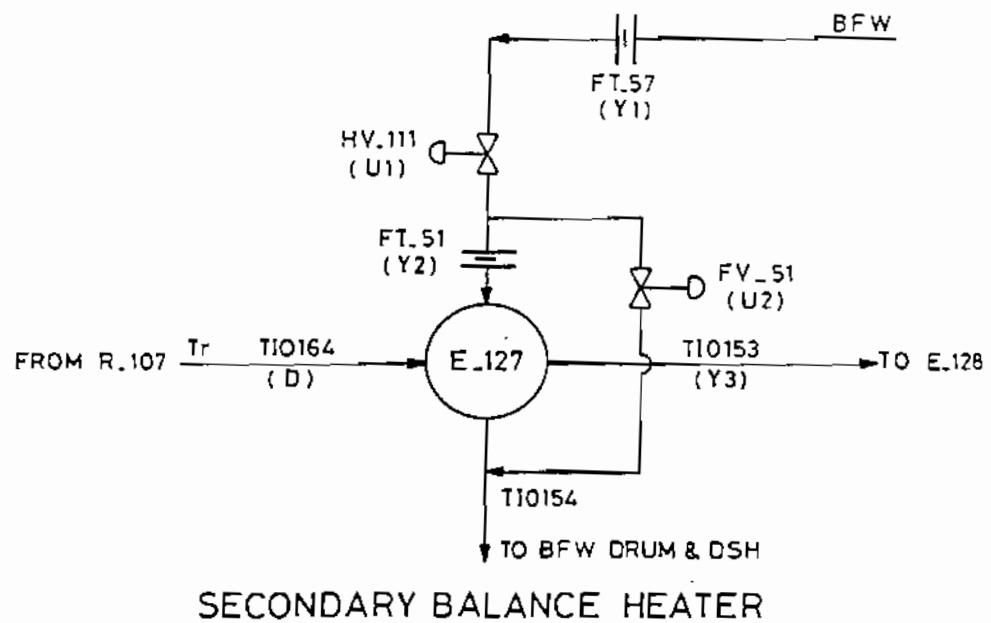


FIG. (3)



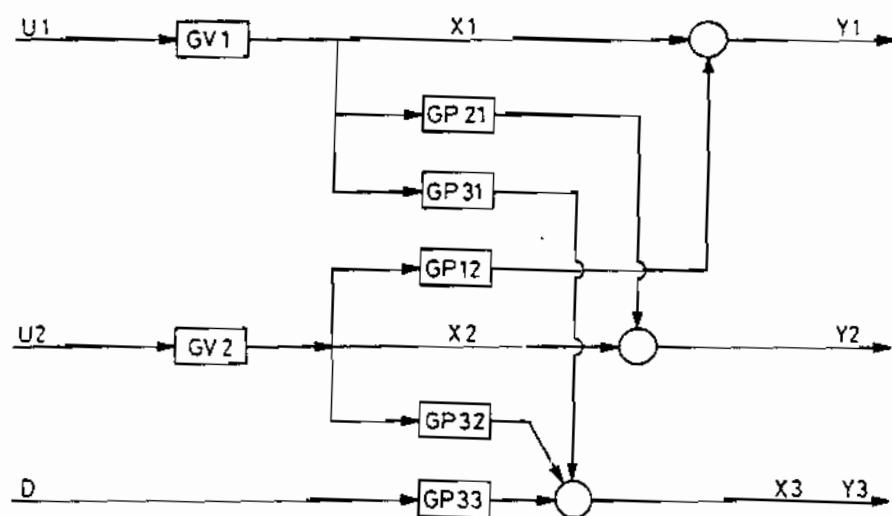


FIG. (4)

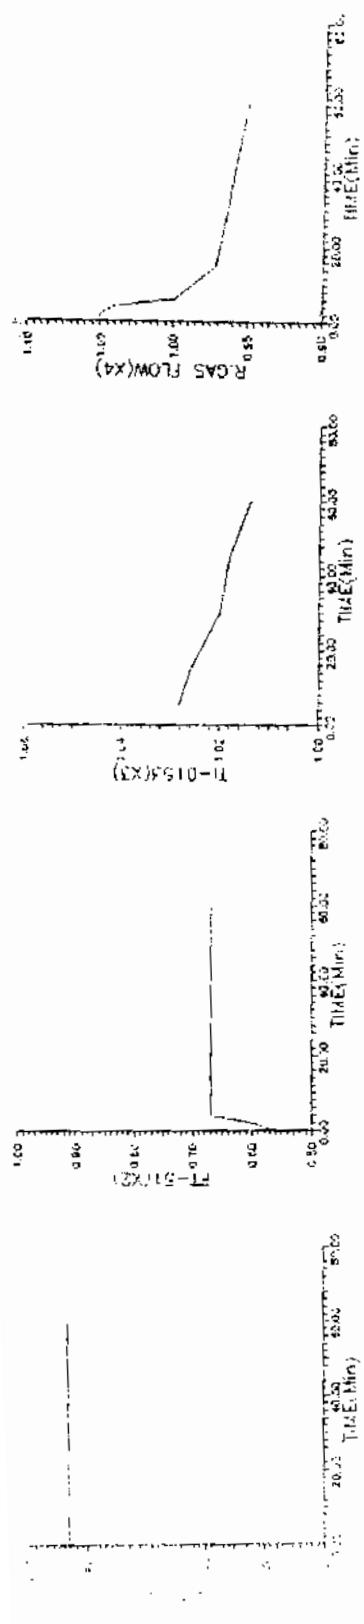

a) Practical recorded values

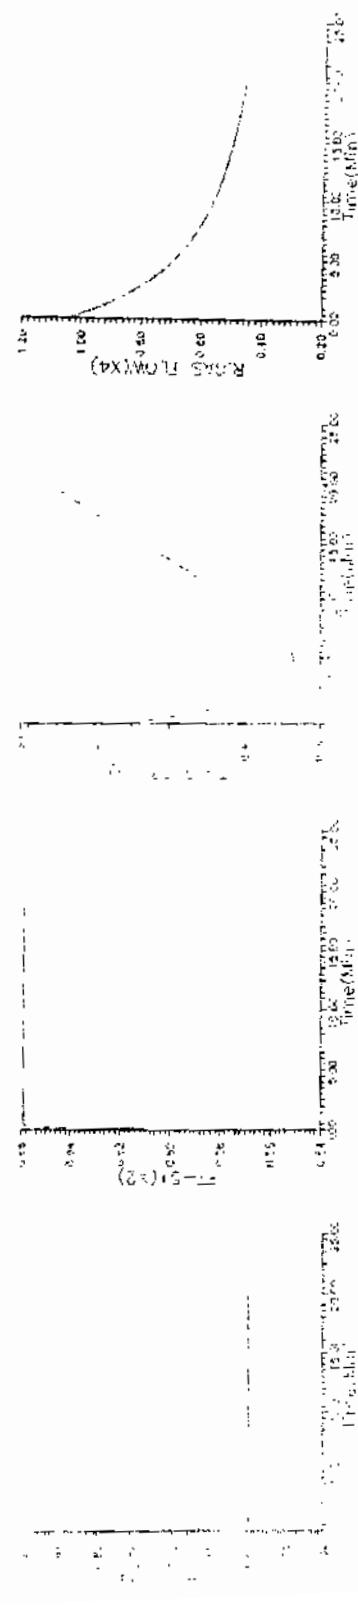

b) numerically calculated values

Fig. C5: Transient response of system state variables.