

2-5-2021

Application of Honeycomb Bed as a Desiccant Carrier for Absorption of Water from Air.

A. Kabeel

Mechanical Power Engineering Department., Faculty of Engineering., Tanta University., Tanta., Egypt.,
kabeel6@yahoo.com

Follow this and additional works at: <https://mej.researchcommons.org/home>

Recommended Citation

Kabeel, A. (2021) "Application of Honeycomb Bed as a Desiccant Carrier for Absorption of Water from Air.," *Mansoura Engineering Journal*: Vol. 25 : Iss. 3 , Article 7.
Available at: <https://doi.org/10.21608/bfemu.2021.146694>

This Original Study is brought to you for free and open access by Mansoura Engineering Journal. It has been accepted for inclusion in Mansoura Engineering Journal by an authorized editor of Mansoura Engineering Journal. For more information, please contact mej@mans.edu.eg.

APPLICATION OF HONEYCOMB BED AS A DESICCANT CARRIER FOR ABSORPTION OF WATER FROM AIR

امتصاص بخار الماء من الجو بواسطة طبقة من القماش على شكل خلية النحل

A. E. Kabeel

Faculty of Engineering, Mechanical Power Department,
Tanta University Egypt

خلاصة :

في هذا البحث تم عمل دراسة نظرية ومعملية حول استخدام طبقة من القماش مشكلة على هيئة شمع غسل النحل بعد تشريبها بمحلول كلوريد الكالسيوم بفرض امتصاص رطوبة الجو. في النموذج الرياضي تم تناول ومناقشة تأثير العوامل المختلفة على عملية الامتصاص وتشمل هذه العوامل كل من درجة حرارة وكمية السريان ورطوبة الجو بالإضافة الى خواص المحلول الملحي المستخدم في الجزء العملي من البحث تم تجهيز نماذج متشابهة كل شـ. زج على شكل شمع غسل النحل وتم وضعها في قناة هوائية على التوالي. اجريت التجارب عند درجات حرارة مختلفة ومعدلات متغيرة لسريان الهواء الجوي وتم مقارنة معدلات الامتصاص بالنسبة للوحدات الثلاثة وقد تم عمل مقارنة بين نتائج النموذج الرياضي والقياسات المعملية ومناقشة النتائج.

ABSTRACT

In the present work, the application of a thick layer of cloth in a honeycomb form for the absorption of water vapour from atmospheric air is investigated. Three equivalent cells are arranged in series and the air stream is allowed to flow through them. Liquid Calcium Chloride is applied as the absorbing material. Each cell is impregnated with the desiccant (CaCl_2) where the cloth layer functions as a desiccant carrier. In the theoretical model, the effect of various parameters on the absorption process is analyzed. Dimensionless variables are also presented with the corresponding physical meanings. Comparison between the experimental results and the theoretical model show that the agreement is reasonable.

INTRODUCTION

The rapid increase of population and the industrial development has raised the demand of fresh water. The atmospheric air contains a higher quantity of water vapour of about 14000 Km^3 , while the amount of water on the earth is only about 1200 Km^3 [1]. The extraction of fresh water from the atmospheric air can be carried out by two different process. The first process by passing the moist air over a cooling coil of an air conditioner, moisture is separated if the effective coil temperature is lower than the dew point. In the second process, water is extracted by absorption on-to a solid absorbent or over hygroscopic solution with subsequent heating of these substance in order to evaporate water. The cooling/dehumidification process is analyzed and the parameters controlling the heat and mass transfer rate are studied by Khalil [2]. Awad et al. [3] described the application of a simple vapour- compression refrigeration cycle for cooling moist air to a temperature lower than its dew point where condensation of moisture occurs. Gandhidasan et al [12], studied the theoretical relation for selection of optimum cooling temperature. Sofrata, [4] described the operation of a system extracting the water from outdoor air based on adsorption-desorption process using a solid desiccant. Analysis of transient heat/mass

transfer and adsorption-desorption interaction can be found in ref. [5]. Hamed [6] carried a theoretical study to extract the water from the atmospheric air using solar energy by using Calcium Chloride (CaCl_2) solution as a liquid desiccant. Gad et al, [7] presented theoretical and experimental investigation on the application of corrugated surface of desiccant bed, which is made of a thick layer of cloth carrying CaCl_2 solution as the absorbent solution and evaluate the effect of solar radiation intensity and ambient temperature on the system productivity..

However, the effect of shape of the bed carrier is less investigated. On the other hand, enhancing the mass transfer area is expected to increase the rate of absorption. In the present work, investigation the process of absorption of water from air is carried out on a honeycomb bed, which is made of a thick layer of a cloth impregnated with CaCl_2 desiccant. The bed consists of three cells arranged in series. The aim of this study is to evaluate the effect of the different parameters (air flow rate and inlet temperature) on the absorption rate and study the effect of this variables on the three cells.

THEORETICAL ANALYSIS

The rate equation describing the absorption process can be given as

$$\frac{dM}{d\tau} = \beta \cdot A \cdot (P_v - P_s) \quad (1)$$

where M is the mass of absorbed water in the bed, τ is the absorption time, β is the mass transfer coefficient, A is the absorption area, P_v and P_s is the water vapour pressure in the air stream and on the bed surface.

The mass transfer coefficient, β is dependent on the coefficient in gas side and in desiccant side.

$$\frac{1}{\beta} = \frac{1}{\beta_g} + \frac{1}{\beta_b} \quad (2)$$

where β_g . β_b are the values of mass transfer coefficient in the gas side and bed side, respectively. Values of β can be evaluated from the experimental results.

The enthalpy of the absorbent can be evaluated from the energy balance of the bed.

$$\frac{dI_b}{d\tau} = U \cdot A \cdot (T_a - T_b) + \beta \cdot A \cdot L \cdot (P_v - P_s) \quad (3)$$

where U is the heat transfer coefficient from the air stream to the bed, T_a and T_b are the temperatures of the air stream and bed surface, respectively and L is the latent heat of water vapour.

The solution concentration is generally defined as the ratio between the mass of salt M_s in solution to the mass of sorbent as,

$$X = \frac{M_v}{M_w + M_v} \quad (4)$$

where M_w is the mass of water in the solution.

The theoretical analysis of the process of water absorption from the air is presented by Hamed and Proselkov [11]. The model describes the variation of the effect of operating parameters on the absorption process.

The final solution of system of equations can be given in the following dimensionless form [11],

$$\bar{X} = \bar{P} - (\bar{P} - \bar{X}_\infty) \text{EXP}(-\bar{A}) \quad (5)$$

where:

$$\bar{X} = \frac{1-X}{X} \quad (6)$$

$$\bar{X}_\infty = \frac{1-X_\infty}{X_\infty} \quad (7)$$

$$\bar{A} = \frac{p \cdot \beta \cdot c \cdot \tau}{M_s / A} \quad (8)$$

$$\bar{P} = \frac{1-X_0}{X_\infty} \quad (9)$$

where X_∞ is the concentration at the end of absorption.

In the analysis presented by [11] is based on the approximate relation, which defines the effect of descent concentration on the vapour pressure at different temperatures with accuracy in the range from 20-30%. However the relation between the vapour pressure, concentration and temperature is more precisely expressed by [6] with accuracy of about 6% is given as,

$$\text{Log}(P_v) = A(x) - \frac{B(x)}{t + 111.96} \quad (10)$$

$$A(x) = a_0 + a_1 X \quad (11)$$

$$B(x) = b_0 + b_1 X$$

where $a_0 = 10.0624$, $a_1 = 4.4674$, $b_0 = 739.828$, $b_1 = 1450.96$, t is the solution temperature in $^{\circ}\text{C}$, X is the concentration of the solution in the cell. Equation (10) is applicable in range of water from 6.62 mmHg to 76.2 mmHg.

Accordingly the effect of various parameters on the absorption process can be presented in the following analysis, considering equation (10).

From equation (11)

$$P_s = e^{A(X) - \frac{B(X)}{t+c}} \quad (12)$$

where $e=111.96$, substituting equation 1 in equation 12

$$\frac{dM_w}{dt} = \beta \cdot A \cdot (P_v - e^{A(X) - \frac{B(X)}{t+c}}) \quad (13)$$

$$\frac{dM_w}{P_v - e^{a_0 + a_1 \cdot X - ((b_0 + b_1 \cdot X)/t+c)}} = \beta \cdot A \cdot dt \quad (14)$$

from equation (4) in equation (14)

$$\frac{dM_w}{P_v - e^{a_0 + a_1 \cdot \frac{M_s}{M_s + M_w} - ((b_0 + b_1 \cdot \frac{M_s}{M_s + M_w})/t+c)}} = \beta \cdot A \cdot d\tau \quad (15)$$

Assume

$$Y_1 = P_v - e^{a_0 + a_1 \cdot \frac{M_s}{M_s + M_w} - ((b_0 + b_1 \cdot \frac{M_s}{M_s + M_w})/t+c)} \quad (16)$$

$$\frac{dY_1}{dM_w} = a_1 \cdot \frac{X^2}{M_s} + b_1 \cdot \frac{X^2}{M_s(t+c)} e^{a_0 + a_1 \cdot X - ((b_0 + b_1 \cdot X)/t+c)} \quad (17)$$

from equation 17, assume

$$Y_2 = \frac{X^2}{M_s} (a_1 + \frac{b}{t+c}) e^{a_0 + a_1 \cdot X - ((b_0 + b_1 \cdot X)/t+c)} \quad (18)$$

from equation 15,16,17 and 18

$$\frac{1}{Y_2} \log Y_1 = \beta \cdot A \cdot \tau + c, \quad (19)$$

at $\tau=0$ $X = X_0$, $t = t_0$

$$Y_3 = P_v - e^{a_0 + a_1 \cdot \frac{X_0^2}{M_s} - ((b_0 + b_1 \cdot \frac{X_0^2}{M_s})/t_0+c)} \quad (20)$$

$$Y_4 = \frac{X_0^2}{M_s} (a_1 + \frac{b}{t_0+c}) e^{a_0 + a_1 \cdot X_0 - ((b_0 + b_1 \cdot X_0)/t_0+c)} \quad (21)$$

$$c_1 = \frac{1}{Y_4} \log Y_3 \quad (22)$$

from equation 19

$$Y_4 \log Y_1 + Y_2 \log Y_3 = Y_2 Y_4 \beta A \tau \quad (23)$$

EXPERIMENTAL SET UP

Figure (1) shows a schematic of the experimental system. The aim of the experimental work is to study the performance of the honeycomb bed saturated by the Calcium-Chloride and compare the results with the output of the theoretical model. The system consists of centrifugal fan with variable velocity from 0 to 1450 r.p.m in order to control the amount of air stream, variable power heater to control of the temperature of the inlet air to the cells, measuring instruments and test section. The test section consists of three identical cells (18 cm x 18 cm x 5 cm) in arranged series. Each cell is made of aluminum wire which is welded together to gave honeycomb cross section. A thick layer of cloth around the honeycomb was used as a bed carrying the desiccant solution. Each cell is weighed and then impregnated in the desiccant solution. The ambient humidity ratio is determined with the measured dry -bulb and wet-bulb temperatures of the air stream. During the absorption, the mass of each cell is recorded during the experimental test every 5 minutes in order to evaluate the mass of absorbed water during this time. The experiments were carried out at different values of air flow rate (0.00324, 0.029, 0.0389, 0.04536, .06395 Kg/s) and at different inlet temperatures to cells (21, 22, 23, 25, 27 °C). Variation of solution concentration is evaluated by knowledge the mass of absorbed water at different time. The air stream velocity is measured with a hot wire anemometer. Temperatures at inlet and outlet sections are measured at different points using thermocouples and the average value is evaluated.

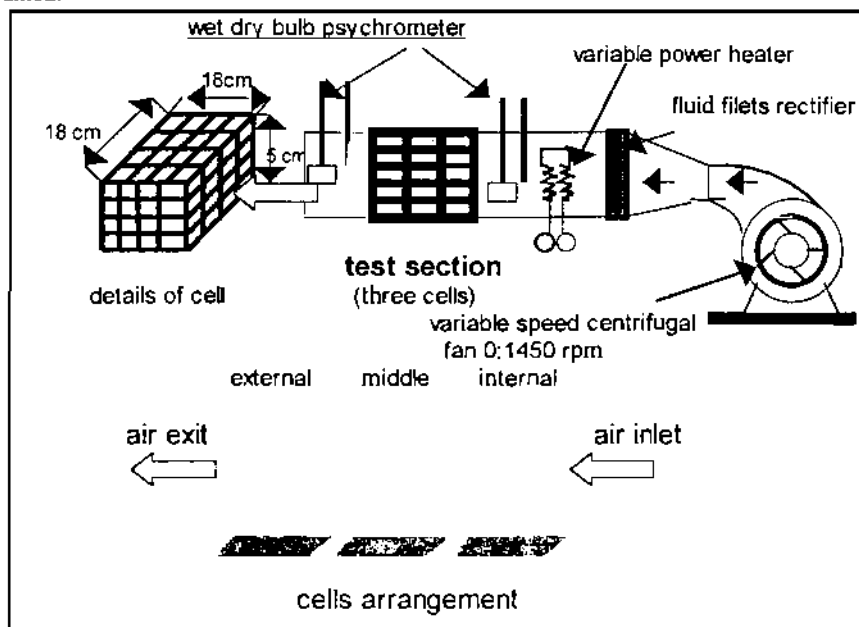


Fig. 1: experimental set up

EXPERIMENTAL PROCEDURE

Since CaCl_2 salt is not volatile, the concentration of the solution can be calculated from the following equation:

$$X_o.M_o = X_r.M_r \quad (24)$$

where:

X_o is the initial concentration, M_o is the initial mass of solution in the bed.

$$M_r = M_t - M_b \quad (25)$$

where M_b is the mass of the dry bed, M_t is the total mass of bed and solution.

The humidity ratio of air can be calculated at bed exit from the following equation:

$$W_o = W_i - \frac{\Delta m}{\Delta \tau . m_a} \quad (26)$$

The vapour pressure in the air calculated from this equation:

$$P_v = \frac{W_o . P}{0.622 + W_o} \quad (27)$$

P_a is the atmospheric air pressure, mm Hg.

The mass transfer coefficient β can be evaluated from the following relation,

$$\beta = \frac{\Delta m}{\Delta \tau \Delta P A} \quad (28)$$

where, Δm is mass of absorbed water and $\Delta \tau$ is absorption period.

$$\Delta P = P_v - P_i \quad (29)$$

RESULTS AND DISCUSSIONS

The experimental tests are carried out at different inlet air temperatures and different mass flow rates. Experiments aims at studying the absorption characteristics of a honeycomb bed impregnated with liquid desiccant. Also, the effect of air temperature and mass flow rate on the absorption are demonstrated. Comparison between the experimental results and theoretical results is also discussed.

Two groups of the experimental tests are carried out on the honeycomb section. In the first group, at different values of the inlet air temperature and fixed mass flow rate. The second group of the experimental work is carried out at different mass flow rates, 0.00324, 0.029, 0.0389, 0.04536 and 0.06395 Kg/s at fixed inlet air temperature..

Figures 2,3 and 4 illustrate the variation of the absorbed mass of solution in bed at different temperatures for the three cells of the bed at constant flow rate of 0.06395 Kg/s. It can be observed that the mass of absorbed solution increases with decreasing the temperature, the maximum value is about 27 gm for the external cell, 28 gm for the middle cell, and 30.5 gm for the internal cell is recorded, which proves that the accumulated mass of absorbed water decreases with the duct depth. Also, it is found that increasing the value of the absorbed water due to temperature decrease of 27 C to 21 C is about 10.5 gm. The time required to reach equilibrium with ambient air increases with decreasing the temperature. It reached to 30 minute at inlet temperature 27 C and reached to 100 minute at temperature equals 21 C. Comparing the experimental results of the three cells, it can be observed that the rate of absorption of water increases with decrease in air stream temperature. This can be explained by the fact that, the decrease in air stream temperature, however does not effect on the vapour pressure in ambient air but decreases the desiccant temperature and consequently decreases the vapour pressure on the desiccant surface which result in increase in vapour pressure difference between air and desiccant.

The variation of absorbed mass of solution versus time for different flow rate at constant inlet temperature to the cells is presented in Fig. 5, 6 and 7. It can be seen from the figures that the absorption rate increases with the increasing amount of the flow rate. It reached to 27 gm for the external cell, 28 gm for the middle cell and 30.5 gm for the internal cell.

Figures 8, 9 and 10 show the variation of the concentration of the solution at different temperatures with the constant flow rates (0.06395 Kg/s) for the three cells. It can be observed that the concentration decreases with the time. The concentration reached to about 40 % for cell and for the internal cell reached to about 37.5%

Also, the transient value of solution concentration at different flow rates and constant temperature is presented in Fig. 11, 12 and 13. For a given absorption period, the final concentration of the desiccant is shown to be highly dependent on the flow rate. For example (Fig. 9), for the middle cell, the concentration reached about 40% when the flow rate is 0.06395 Kg/s and reached to 54 % at flow rate decreased to 0.0324 Kg/s.

Figure (14) shows the variation of the vapour pressure on the solution surface with time at flow rate equals 0.06395 Kg/s for the three cells. It can be seen that the value increases with time and changes from about 1.5 mm Hg to 7.8 mm Hg. The variation of the vapour pressure in the air versus time at flow rate equals 0.06395 Kg/s is illustrated in Fig. (15). The value decreases with time and changes from 7.4 mm Hg to 6.6 mm Hg after 100 minutes for the internal cell.

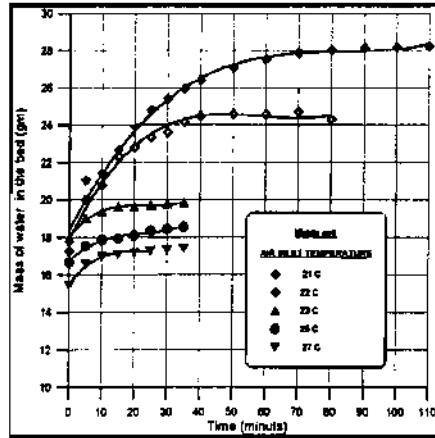


Fig 2: Variation of the mass of solution absorbed in the bed for middle cell at constant mass flow rate 0.0639 kg/s

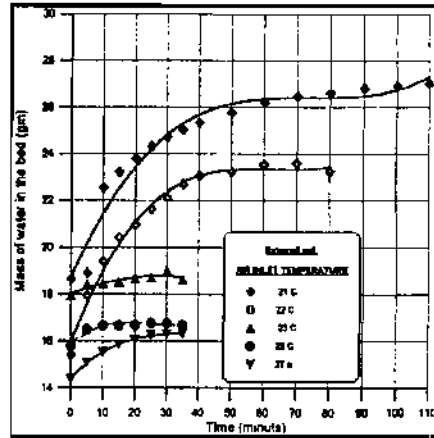


Fig 3: Variation of the mass of water absorbed in the bed for external cell at constant mass flow rate 0.0639 kg/s

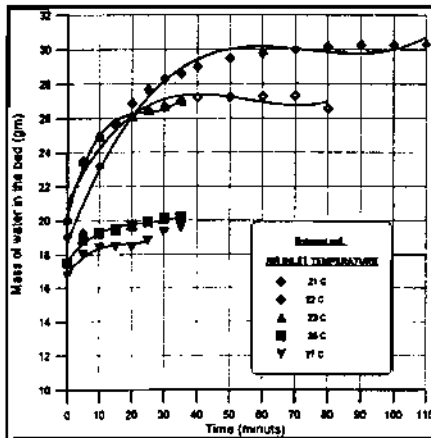


Fig 4: Variation of the mass of solution absorbed in the bed for internal cell at constant mass flow rate 0.0639 kg/s

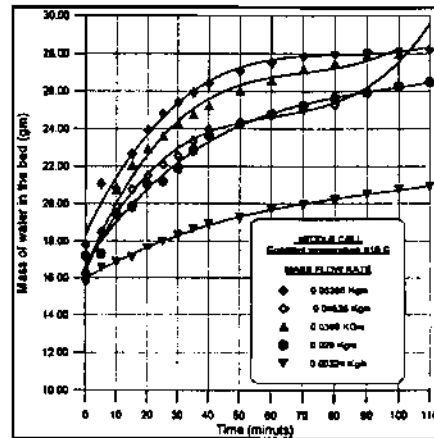


Fig 5: Variation of the mass of solution absorbed in the bed for middle cell at constant temperature 19°C

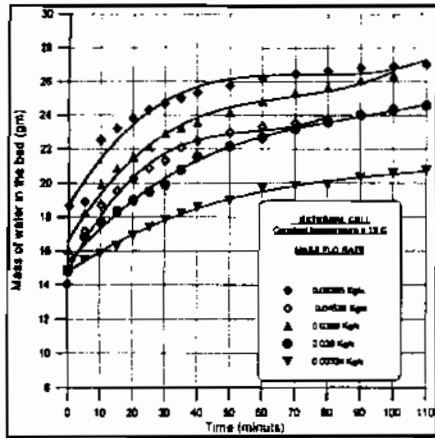


Fig 6: Variation of the mass of water absorbed in the bed for external cell at constant temperature 19 C

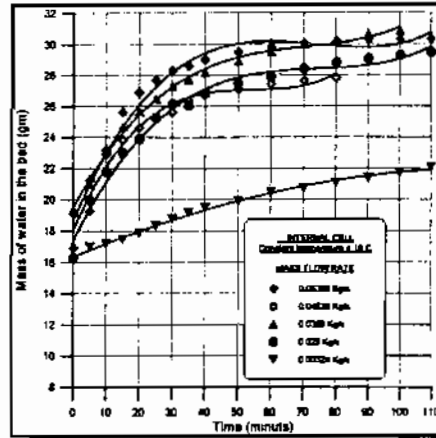


Fig 7: Variation of the mass of water absorbed in the bed for internal cell at constant temperature 19 C

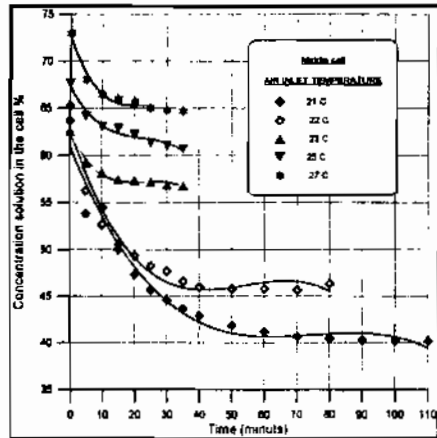


Fig 8: Variation of the concentration of solution of a middle cell absorbed in the bed at constant mass flow rate 0.0639 kg/s

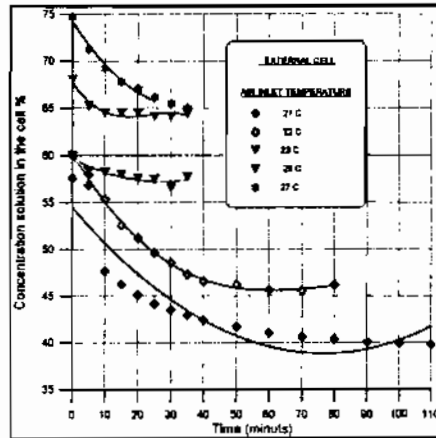


Fig 9: Variation of the concentration of solution of the external cell absorbed in the bed at constant mass flow rate 0.0639 kg/s

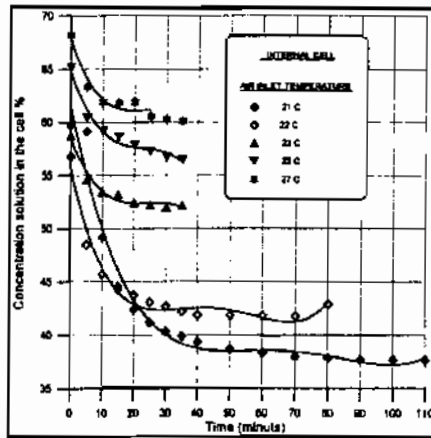


Fig 10: Variation of the concentration of solution of the internal cell absorbed in the bed at constant mass flow rate 0.0639 kg/s

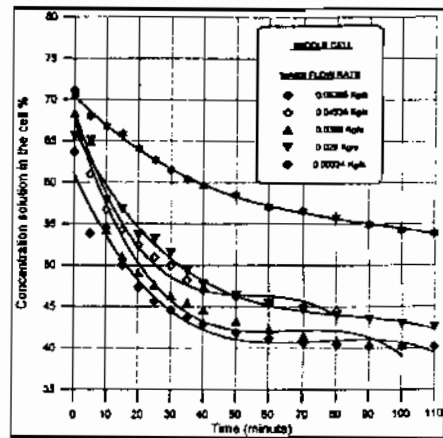


Fig 11: Variation of the concentration of solution of the middle cell absorbed in the bed at constant temperature 21 C

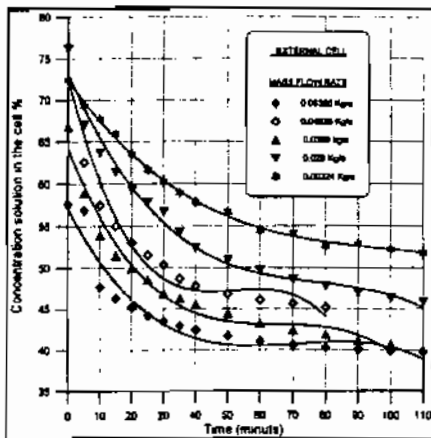


Fig 12: Variation of the concentration of solution of the external cell absorbed in the bed at constant temperature 21 C

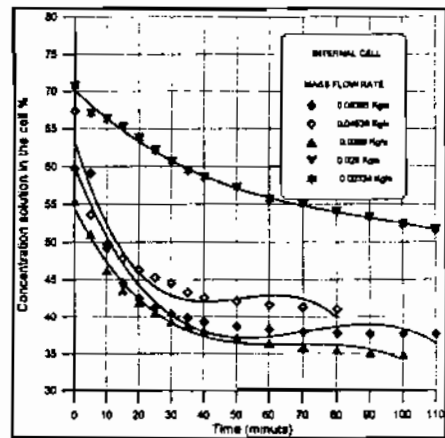


Fig 13: Variation of the concentration of solution of the internal cell absorbed in the bed at constant temperature 21 C

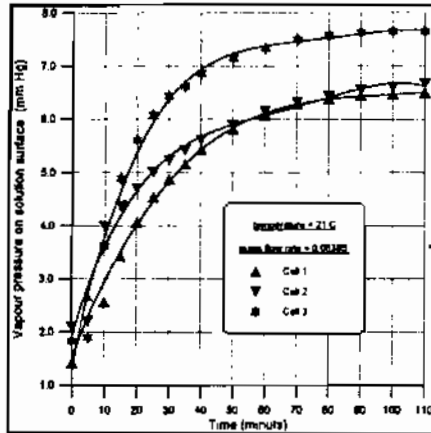


Fig 14: Variation of the vapour pressure on solution surface in the cells at flow rate equal 0.06395 Kg/s

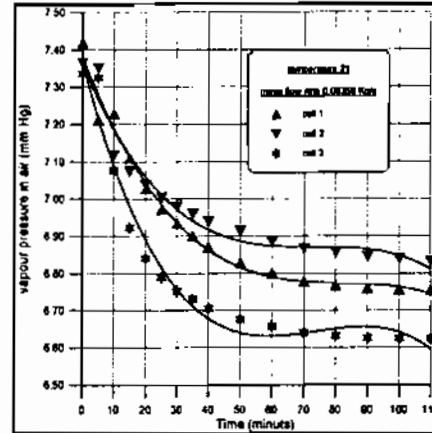


Fig 15: Variation of the vapour pressure in air for the cells at flow rate equal 0.06395 Kg/s

Comparison between experimental results with the present theoretical results and the previous theoretical results [11] are given in Fig. 16. The difference between the experimental results and theoretical data can be explained as follows: During the experimental tests humidity ratio of air stream varies of from 7 to 9 gm/Kg_{air}. However, in theoretical calculations it is assumed that the inlet humidity of air is constant. This assumption results in constant values of X_w which actually variable during the experiments. Also, the mass transfer coefficient is assumed constant in theoretical calculations. The value of β ,

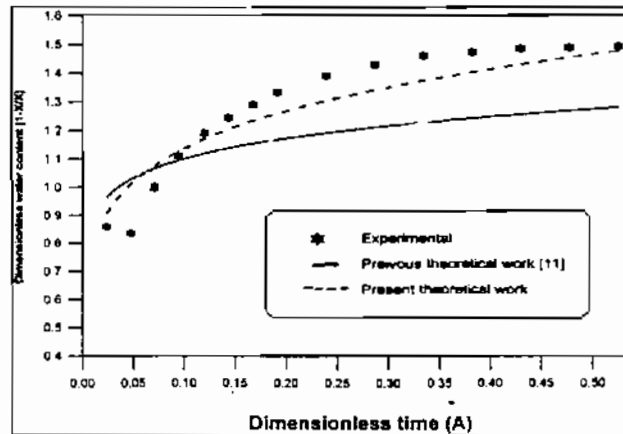


Fig 16: Variation of the dimensionless water content with dimensionless time

however, depends on air stream velocity and the variable thermo-physical properties of the Calcium Chloride solution. Also results show good agreement between present theoretical and experimental results.

The theoretical and experimental study on the transient adsorption characteristics of vertical packed porous bed was studied by Hamed [13]. Figure 17 shows the comparison between the experimental results of previous work [13] and the present work for the variation of solution concentration. It can be observed that the time required for change in the concentration from 55% to 40% is about 90 minutes for the present work and about 300 minutes for the previous work. Which means that the rate of absorption can be enhanced with application of honeycomb bed as desiccant carrier.

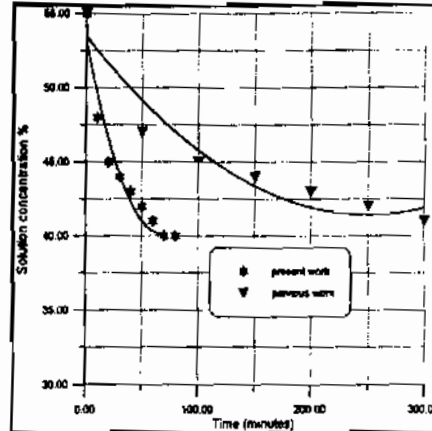


Fig. 17: Comparison between this work and previous work

CONCLUSIONS

An investigation on the application of honeycomb bed as a desiccant carrier for absorption of water from atmospheric air is carried out. The effect of operating conditions; inlet temperature and flow rate of the air stream on the absorption process of CaCl_2 desiccant was studied. The average values of the mass transfer coefficient for the different cells are evaluated. Also results show good agreement between theoretical and experimental results. Results shows that the absorption rate can be enhanced with application of honeycomb bed.

REFERENCES:

- 1- Obrezkova, V. E., "Hydro-energy", Energoatomezdat, moscow, 1988
- 2-Adel Khalil, "Dehumidification of atmospheric air as a potential source of fresh water", UAE. Desalination, 34, 1993, 587-596.
- 3-Awad M. M, Sultan A. A., Abdel Raouf M. M., "Using refrigeration systems to extract water from moist air", Proceeding of 1st UAE conference on air conditioning in Gulf, ACG, 1996, pp.96.
- 4-Sofrata, H., "Non-Conventional system for water collection", Proc. of Solar Desalination Workshop 2. pp. 71-87, 1981.
- 5-Fedorov, A. G. and Viskanta, R., "Analysis of transient heat / mass transfer and adsorption / desorption interactions", Int. Journal of Heat and Mass Transfer, 42, pp. 803-819, 1999.
- 6-Ahamed M. Hamed: "Absorption-regeneration cycle for production of water from air-theoretical approach", Renewable Energy, 19, pp. 625-635, 2000.
- 7-Gad H. E., Hamed A. M., El-sharkawy E., "Application of solar desiccant/collector system for water recovery from atmospheric air", Mansoura Engineering Journal, (MRJ), Vol. 24, No. 4, December 1999.
- 8-Y. Alayli, N. E. Hadji and J. Leblond: "A new process for extraction of water from air", Desalination 67, pp. 227-229, 1987.

- 9-YU. Aristov, M. M. Tokarev, L. G. Gordeeva and V. N. Snytnikov, "New composite sorbents for solar-driven technology of fresh water production from the atmosphere", *Solar Energy*, Vol. 66, No. 2, 165-168, 1999.
- 10-Hall, R. C., "Production of water from atmospheric by absorption with subsequent recovery in a solar still", *Solar Energy*, 10, pp.42-45, 1966.
- 11- Hamed A. M., Proselkov, "Theoretical study on the absorption process using porous material impregnated with desiccant solution", *Chemical Industry, Russian*, 1993.
- 12-Gandhidasan, P. and Abualhamayel, H. I., "Water recovery from atmosphere", *WREC*, pp. 745-748, 1996.
- 13-Hamed A. M. Theoretical and experimental study on the transient adsorption characteristics of vertical packed porous bed Mansoura third International Engineering Conference, Egypt, 2000, pp.61-76.

NOMENCLATURE

A	absorption area, m ²
a,c	empirical constants of equation (4)
c ₀	integration constant of equation (6)
I	enthalpy of absorbent, J/Kg
L	latent heat of water vapour, J/Kg
M	mass of absorbed water in the bed, gm
M ₀	initial mass of solution in the bed, gm
M _t	total mass of bed and solution, gm
M _w	mass of water in solution, gm
M _s	mass of salt in solution, gm.
m _a	air flow rate, Kg/s
P	atmospheric pressure, mm Hg
P _v	water vapour pressure in the air stream, mm Hg
P _s	water vapour pressure on the bed surface, mm Hg.
T _a	temperatures of the air stream, K
T _b	temperatures bed surface, K
U	heat transfer coefficient from the air stream to the bed, W/m.K
W ₀	humidity ratio of air at exit section
W ₁	humidity ratio of air at exit section
X	sorbent concentration,
X ₀	initial concentration.
X _∞	concentration at the end of absorption.
τ	is the absorption time, sec
β	mass transfer coefficient, Kg/sec.m ² .mm Hg
β _v	mass transfer coefficient in the gas side, Kg/sec.m ² .mm Hg
β _b	mass transfer coefficient in the bed side, Kg/sec.m ² .mm Hg
-	
\bar{A}	dimensionless time
\bar{X}	dimensionless water content
\bar{P}	dimensionless water content at equilibrium condition .