

1-30-2021

## Static Device to Keep Symmetry of 3-Phase Supply Feeding Large 1-Phase Loads.

Azza Abdel-Hamid

*Electrical Engineering., Power Department, Cairo University., Cairo., Egypt.*

Follow this and additional works at: <https://mej.researchcommons.org/home>

---

### Recommended Citation

Abdel-Hamid, Azza (2021) "Static Device to Keep Symmetry of 3-Phase Supply Feeding Large 1-Phase Loads.," *Mansoura Engineering Journal*: Vol. 26 : Iss. 2 , Article 11.

Available at: <https://doi.org/10.21608/bfemu.2021.144793>

This Original Study is brought to you for free and open access by Mansoura Engineering Journal. It has been accepted for inclusion in Mansoura Engineering Journal by an authorized editor of Mansoura Engineering Journal. For more information, please contact [mej@mans.edu.eg](mailto:mej@mans.edu.eg).

STATIC DEVICE TO KEEP SYMMETRY OF 3-PHASE  
SUPPLY FEEDING LARGE 1-PHASE LOADS

وسيلة استاتيكية للمحافظة على توازن المنبع الكهربائي ثلاثي-الطور عند تغذية أحمال كبيرة أحادية-الطور

By  
AZZA M.ABDEL-HAMID

Electrical Engineering, Power Department, Cairo University, Cairo, Egypt

خلاصة : عادة يطلب من شبكات توزيع الفري الكهربائية ثلاثية-الطور تغذية أحمال كبيرة أحادية-الطور مثل محولات اللحام والأفران الكهربائية. ومن المعلوم أن هذه الأحمال لها تأثيرات ضارة على توازن الشبكة المغذية ثلاثية-الطور، مما يعرض الأحمال الأخرى المغذية من نفس المصدر- مثل المحركات الحثية ثلاثية-الطور- إلى أداء غير سليم وارتفاع درجة حرارة الملفات مما يرضها للتلف. ويقدم هذا البحث طريقة استاتيكية للمحافظة على التوازن المصدر الكهربائي ثلاثي-الطور وذلك بإضافة مفاعلتين إلى الحمل الكبير أحادي-الطور لتكثرتا مع حمل جماعي موصل بطريقة الدلتا ويؤدي إلى استبقاء الشبكة بالتوازن المطلوب لتغذية الأحمال الثلاثية الأخرى. والبحث يقدم قيمة المفاعلتين (ك.ف.أ) ونوعيتها، وتغير قيمتها مع طبيعة ومقتات الحمل أحادي-الطور ومعامل قدرته. ومن الواضح أن الوسيلة المقدمه لا تستهلك أي طاقة كهربائية اضافية.

**ABSTRACT**

Utility systems must nowadays handle a variety of a large 1-phase industrial loads which can have a serious effect on the symmetry of a 3-phase supply system. This paper introduces a method by which 1-phase loads can be reflected as symmetrical three phase in order to avoid unbalancing the feeding 3-phase supply. For this purpose, a static wattless device is presented which proves to be practicable for any single-phase load. Additionally, the device is more important when the power-factor of the 1-phase load is equal or near unity.

**keywords:** Static device, 1-phase loads, Symmetry of supply.

**NOMENCLATURE.**

- $a$  = operator  $e^{j120}$ .
- $I_0, I_1, I_2$  = Zero-, positive -, and negative-sequence components of the current "I".
- $P_1$  = Power component of the single-phase load, Watt.
- $P_p$  = Pulsating double-frequency component of the 1-phase load.
- $P_3$  = Power of the 3-phase supply.
- $R_1$  = Resistance of the 1-phase load, Ohm.
- $U_{i0}, U_{i2}$  = Current unbalance-factors of zero- and negative-sequence currents, respectively.
- $U_{v0}, U_{v2}$  = Voltage unbalance-factors of zero-, and negative-sequence voltages, respectively.
- $(VA)_1$  = Apparent-power of the 1-phase load.
- $(VAR)_2, (VAR)_3$  = Reactive-power of the two balancing reactances ( $X_2$ ) and ( $X_3$ ) respectively.

$(VAR)_3$	= Reactive-power of the 3-phase supply .
$X_1$	= Reactive -component of the 1-phase load ,Ohm .
$X_2, X_3$	= Reactances of the static device .
$Z_1$	= Impedance of the 1-phase load ,Ohm .
$\cos\phi_1$	= PF. of the 1-phase load .
$\cos\phi_3$	= PF. of the 3-phase supply .
$\beta_2$	= Ratio of $(VAR)_2$ to $(VA)_1$ .
$\beta_3$	= Ratio of $(VAR)_3$ to $(VA)_1$ .

## (1) INTRODUCTION

Three-phase networks are required nowadays to feed large 1-phase loads like traction systems, welding transformers, arc furnaces, etc [1]. Such loads may have harmful effects upon the 3-phase system, especially voltage symmetry. The limit to voltage unbalance was set at 2% in BS2613 for the satisfactory operation of 3-phase motors, since values higher than this could cause excessive heating of motor-windings [2,5]. However, to allow for a measure of unbalance from other causes, the supply authorities have recommended maximum unbalance figures of 1-3% below 33 KV. Obviously, the presence of large 3-phase induction-motors and 3-phase synchronous-machines help to maintain the symmetry of the 3-phase supply within the permissible limits [1,3].

It is therefore highly required to reflect such large 1-phase loads in effect to 3-phase to keep the balance of the 3-phase distribution system. Clearly any method serving this purpose must compensate the double-frequency power component drawn from the supply by 1-phase loads.

In this paper a static device, applying two reactances to counter the 1-phase load, is presented and analyzed. Clearly, no extra electric-energy is consumed by the device, but the values of the reactances are critical and depend on the power-factor of the 1-phase load. It will be shown that the method is always practicable, but it becomes more useful with 1-phase load power-factor equal to or near unity.

## (2) POWER CONSIDERATION

### (2.1) 1-PHASE CIRCUIT

In a 1-phase circuit fed from a voltage "v", and drawing a current "i" given by :

$$v = v_m \cdot \sin(\omega t + \theta_v)$$

$$i = i_m \cdot \sin(\omega t + \theta_i)$$

the instantaneous- power is the product of both, thus :

$$p = VI[\cos(\theta_i - \theta_v) - \cos(2\omega t + \theta_i + \theta_v)] \quad (1)$$

The last expression shows that the steady power consumed is:

$$P = VI \cos(\theta_r - \theta_i) = VI \cos(\varphi) \quad (2)$$

and the component of power pulsating at double-frequency is:

$$P_p = -VI \cos(2\omega t + \theta_r + \theta_i) \quad (3)$$

Obviously, the pulsating component has an average value equal to zero. Also, the power-factor angle of the 1-phase current is equal  $(\theta_r - \theta_i) = \varphi$ , or with  $\theta_r$  taken zero, i.e. voltage is the reference vector, the PF, angle will be  $\varphi = \theta_i$ . With pure inductive load " $\varphi$ " is then  $(-\pi/2)$  and eq. (3) yields for the alternating-component: It is observed that the amplitude of the alternating-component is equal to the apparent-power of the 1-phase load.

$$P_p = VI \sin(2\omega t) \quad (4)$$

### (2.2) 3-PHASE SYMMETRICAL CIRCUITS

In a symmetrical 3-phase circuit, the 3-phase voltages  $v_a, v_b, v_c$  form together a balanced system, similarly will be the 3-phase currents  $i_a, i_b, i_c$ . Summing up the three instantaneous phase power  $v_a i_a, v_b i_b, v_c i_c$ , as illustrated for the 1-phase circuit above, we finally get the constant power component.

and the sum of the instantaneous-components of the three phases alternating at double-frequency boils down to zero.

$$P = 3VI \cos(\varphi) \quad (5)$$

### (2.3) 3-PHASE ASYMMETRICAL CIRCUITS

The usual method of analyzing such circuits is by the use of the principle of symmetrical-components in which the unbalanced systems of voltages and currents are generally analyzed into three systems, namely the positive-, the negative- and the zero-sequence systems [6]. The positive-sequence voltage and current components represent the normal case of balanced operation. The negative-sequence components are the same but with reversed phase-sequence. But the zero-sequence components represent in-phase voltages and in-phase currents and, consequently, the condition will be similar to those existing in 1-phase circuits. The total power in the 3-phase unbalanced circuit is equal to the sum of positive-negative and zero-sequence powers, thus given by:

$$P = P_0 + P_1 + P_2 \quad (6)$$

in which  $P_1, P_2$  can be obtained exactly as in ordinary balanced 3-phase circuits, and  $P_0$  as in 1-phase circuits. According to the sequence-rule for unbalanced circuits [6], the only terms which contribute to the total power are those in which

$$\begin{aligned} (\text{Total VA}) &= 3.[V_0' I_0 + V_1' I_1 + V_2' I_2] \\ &= P + jQ \end{aligned} \quad (7)$$

the voltage and current have the same sequence order. The total Volt-ampere is then expressed by:

in which subscripts 0,1,2 express zero-, positive-, and negative-sequence quantities; values with the dash ( ' ) are conjugates. The power component "P" and the reactive component "Q" in eq. (7) yield the so called aggregate or total PF. as given by:

Considering  $P_1$  and  $P_2$  in eq. (6), they contain no alternating instantaneous -

$$\text{Aggregate Power - Factor} = \frac{P}{\sqrt{P^2 + Q^2}} \quad (8)$$

power component; but the zero-sequence power component  $P_0$  results in a power component alternating at double-frequency. Consequently, symmetrical distribution of the load in 3-phase networks is always aimed at. With large rating 1-phase loads, this is not easy to achieve and such 1-phase loads are preferably converted so as to be reflected as 3-phase on the 3-phase supply.

The unbalance in a 3-phase supply is normally measured by voltage and current unbalance factors:  $U_{v0}, U_{v2}, U_{i0}, U_{i2}$  as follows:

$$\begin{aligned} U_{v0} &= V_0 / V_1 \\ U_{v2} &= V_2 / V_1 \\ U_{i0} &= I_0 / I_1 \\ U_{i2} &= I_2 / I_1 \end{aligned} \quad (9)$$

#### (2.4) SEQUENCE COMPONENTS OF 1-PHASE LOAD

If a single -phase load is connected between lines S and T of a 3-phase RST supply, the three line -currents  $I_R, I_S$ , and  $I_T$  will then be equal to (0), ( $I_L$ ) and ( $-I_L$ ) respectively, as shown in Fig.(1). The sequence-components of the three line-currents will be:

$$\begin{aligned} I_{R0} &= 0 \\ I_{R1} &= +j.I_L / \sqrt{3} \\ I_{R2} &= -j.I_L / \sqrt{3} \end{aligned} \quad (10)$$

This shows that the zero-sequence component disappears, while the positive- and negative-sequence currents are equal.

#### (2.5) HARMFUL EFFECTS OF SUPPLY ASYMMETRY

The following main effects are caused by supply asymmetry:

- 1- Distribution and transmission losses are increased with asymmetrical loading which may add negative- and zero-sequence currents to the normal positive-sequence current in case of symmetrical loading. When feeding small

- consumers, like lighting loads and house appliances, symmetry may more or less be maintained in 3-wire or 4-wire distribution systems by observing the lines to which such large number of small loads are connected. But with high-rating loads, this would not be possible.
- 2- With 3-phase synchronous-machines, the negative-sequence magnetic-field loads the damper-windings and heats them up, together with the insulating materials applied in the machine. Such overheating greatly affects the longevity of the machine. Furthermore, the negative-sequence currents cause harmonics in stator- and rotor-circuits which lead to over currents especially when capacitors are used.
  - 3- Asymmetrical loading causes in turn asymmetrical voltage-drop, therefore load-voltage will be asymmetrical. Operation of synchronous and induction machines will then suffer from the negative- and zero-sequence voltages leading to reduction of torque and efficiency, dips in the (T/ speed) characteristics that may endanger the running-up process; moreover the longevity of the machine may be greatly affected. Further effects include interference with electric equipments, computers, and fluctuation of the candle-power of tungsten lamps.
- It follows that it is worthwhile to maintain the symmetry of a 3-phase supply as far as possible, though this aim necessitates some extra cost.

### (1) CONVERSION OF 1-PHASE LOAD TO 3-PHASE BY TWO REACTANCES

When a 1-phase load,  $Z_1 \angle \phi_1$ , is connected between any two lines R and S of a 3-phase symmetrical supply RST as in Fig.(2), the idea presented here is to connect 2 reactances to form a delta-loop with the 1-phase load and connected to the same 3-phase supply so that the delta-load will then represent a symmetrical 3-phase network. For the analysis, we start with the two reactances replaced by the impedances  $Z_2$  and  $Z_3$  as in Fig.(2).

The line voltages of the symmetrical 3-phase supply are expressed by :

$$\begin{aligned} V_{RS} &= V \\ V_{ST} &= a^2.V \\ V_{TR} &= a.V \end{aligned} \quad (11)$$

The 3-phase currents in the delta-loop, and the 3 line-currents are given by :

$$\begin{aligned} I_{RS} &= V/Z_1 \\ I_{ST} &= a^2.V/Z_2 \\ I_{TR} &= a.V/Z_3 \end{aligned} \quad (12)$$

And

$$\begin{aligned} I_R &= I_{RS} - I_{IR} \\ I_S &= I_{SI} - I_{RS} \\ I_I &= I_{IR} - I_{SI} \end{aligned} \quad (13)$$

From the 3 last equations , we get :-

$$I_R = V \cdot \left( \frac{1}{Z_1} - \frac{a}{Z_3} \right) \quad (14)$$

and

$$I_S = V \cdot \left( \frac{a^2}{Z_2} - \frac{1}{Z_1} \right) \quad (15)$$

Since for the required symmetrical line-currents , the following relation is to be obtained :

$$I_S = a^2 \cdot I_R$$

then , substituting from equations (14) and (15) , we get :-

$$\left( \frac{a^2}{Z_2} - \frac{1}{Z_1} \right) = \left( \frac{a^2}{Z_1} - \frac{1}{Z_3} \right) \quad (16)$$

Therefore , equation (16) leads to the following relation which is necessary for symmetrical line-currents :

$$a^2 \cdot Z_1 \cdot (Z_1 - Z_2) = Z_2 \cdot (Z_1 - Z_3) \quad (17)$$

Now , assuming 2 reactances  $jX_2$  and  $jX_3$  replacing respectively  $Z_2$  and  $Z_3$  , and substituting the following in equation (17) :-

$$\begin{aligned} Z_1 &= R_1 + jX_1 = Z_1 \angle \phi_1 \\ Z_2 &= j \cdot X_2 \\ Z_3 &= j \cdot X_3 \end{aligned} \quad (18)$$

then , the following condition of symmetry will be obtained :

$$ja^2 \cdot X_3 \cdot (R_1 + j \cdot X_1 - j \cdot X_2) = j \cdot X_2 \cdot (j \cdot X_3 - R_1 - j \cdot X_1) \quad (19)$$

It is to be noted that positive- and negative- signs for the reactances represent respectively inductive and capacitive cases . The load is considered to have lagging power-factor ,  $\cos \phi_1$  , which represents the general case .

Now equating the real and imaginary parts on both sides of equation (19), we get respectively :

$$(-1/2).R_1.X_3 + (\sqrt{3}/2).X_3.(X_1 - X_2) = -R_1.X_2$$

and

$$\left(\frac{-\sqrt{3}}{2}\right).R_1.X_3 - (-1/2).X_3.(X_1 - X_2) = X_2.(X_3 - X_1)$$

The above equations can be modified to :-

$$-R_1.X_3 + \sqrt{3}.X_3.X_1 = \sqrt{3}.X_3.X_2 - 2.R_1.X_2 \quad (20)$$

$$-3.R_1.X_3 - \sqrt{3}.X_3.X_1 = \sqrt{3}.X_3.X_2 - 2.\sqrt{3}.X_1.X_2 \quad (21)$$

The last two equations lead to the following results :

$$\frac{X_2}{X_3} = \frac{\sqrt{3}.\tan \varphi_1 + 1}{\sqrt{3}.\tan \varphi_1 - 1} \quad (22)$$

Substituting from equation (22) in equation (21), we get for  $X_3$  the following expression :

$$X_3 = \sqrt{3}.R_1 \cdot \frac{1 + \tan^2 \varphi_1}{1 + \sqrt{3}.\tan \varphi_1}$$

or :-

$$X_3 = \frac{(\sqrt{3}.R_1)}{(\cos \varphi_1)^2 . (\sqrt{3}.\tan \varphi_1 + 1)} \quad (23)$$

Furthermore from equation (22), we get :

$$X_2 = \sqrt{3}.R_1 \cdot \frac{1 + \tan^2 \varphi_1}{\sqrt{3}.\tan \varphi_1 - 1}$$

or

$$X_2 = \frac{\sqrt{3}.R_1}{(\cos \varphi_1)^2 . (\sqrt{3}.\tan \varphi_1 - 1)} \quad (24)$$

It is obvious from equations (23) and (24) that it is always possible to balance any 1-phase load by the two reactances  $X_2$  and  $X_3$  whatever the power-factor of the load may be ; positive and negative values for the reactances represent respectively inductive- and capacitive-values .



### (3.1) SPECIAL CASES OF 1-PHASE LOAD POWER-FACTOR

Equations (23) and (24) give the values of the two reactances required to reflect the 1-phase load at any power-factor as 3-phase on the 3-phase supply side. The following cases will be examined .

#### (a) 1-phase load P.F =1:

For  $\cos \varphi_l = 1$  , equations (23) and (24) yield the following :

$$\begin{aligned} X_2 &= -\sqrt{3}.R_l \quad (\text{capacitive reactance}) \\ X_1 &= +\sqrt{3}.R_l \quad (\text{inductive reactance}) \end{aligned} \quad (25)$$

For this interesting case . the vector diagram is shown in Fig.(3) .

#### (b) 1-phase load P.F= $\sqrt{3}/2$ , lagging:

$$\begin{aligned} X_2 &= \infty \\ X_1 &= +(2.R_l / \sqrt{3}) \quad (\text{inductive reactance}) \end{aligned} \quad (26)$$

Here  $\varphi_l = +30$  . and the required reactances will be :

This shows that balancing is possible by one inductive-reactance " $X_1$ " connected between lines T and R in the general Fig.(2) .

#### (c) 1-phase load P.F = $\sqrt{3}/2$ , leading .

The required reactances will be :

$$\begin{aligned} X_2 &= (-2.R_l / \sqrt{3}) \quad (\text{capacitive reactance}) \\ X_1 &= \infty \end{aligned} \quad (27)$$

Again here balancing is achieved by one capacitor connected between the two lines S and T in Fig. (2) .

#### (d) 1-phase load P.F = zero , lagging .

Here  $\varphi_l = +90$  ., and the following values for  $X_2$  and  $X_3$  can finally be obtained from equations (23) and (27) :

$$X_2 = X_3 = X_l \quad (28)$$

#### (e) 1-phase load P.F = zero , leading .

In this case  $\varphi_l = -90$  , and symmetry is obtained by two capacitive-reactances equal to the load reactance .

$$-X_2 = -X_3 = -X_l \quad (\text{all capacitive}) \quad (29)$$

The following table gives the values of the two reactances  $X_2$  , and  $X_3$  , in terms of load components , which are required for balancing the 1-phase load , for different values of power-factor .

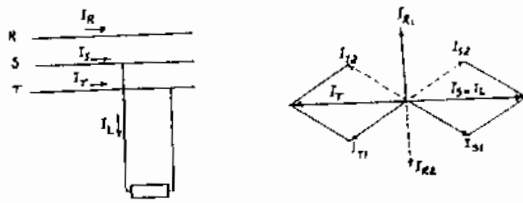


FIG. 1 - SYMMETRICAL COMPONENTS OF 1-PH LOAD

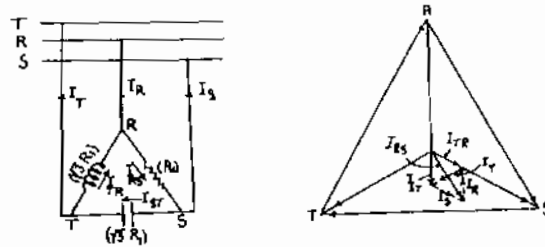


FIG. 3 - CASE OF RESISTIVE LOADING

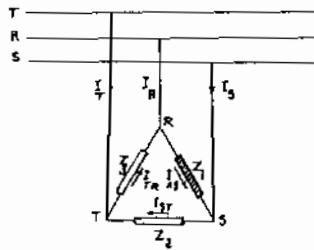


FIG. 2 - GENERAL CASE OF UNBALANCED LOAD

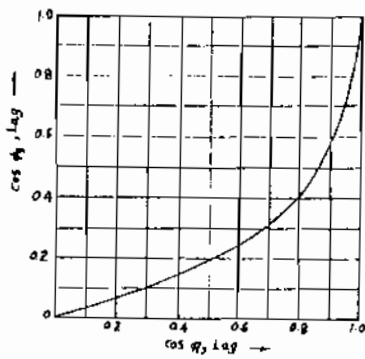


FIG. 4 - VARIATION OF 3-PH SUPPLY PF

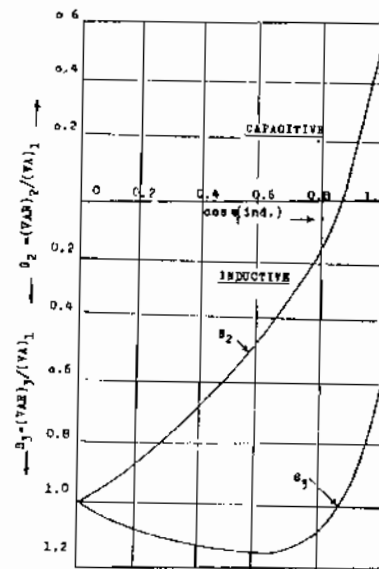


FIG. 5 (REACTIVE VOLT-AMP.) of  $X_0$  and  $X_3$

**Table (A)**

Load P.F	$\phi_1$	$X_2$	$X_3$
1	0	$-\sqrt{3} \cdot R_1$	$+\sqrt{3} \cdot R_1$
0.87 lagging	+30	-	$+2 \cdot R_1 / \sqrt{3}$
0.5 lagging	+60	$+2 \sqrt{3} \cdot R_1$	$+\sqrt{3} \cdot R_1$
Zero , lagging	+90	$+X_1$	$+X_1$
Zero , leading	-90	$-X_1$	$-X_1$
0.5 , leading	-60	$-\sqrt{3} \cdot R_1$	$-2 \cdot \sqrt{3} \cdot R_1$
0.87 , leading	-30	$-2 \cdot R_1 / \sqrt{3}$	-

#### (4) P.F OF THE 3-PHASE SUPPLY AFTER RESTORING SYMMETRY AND THE (VAR) OF THE EXTERNAL REACTANCES

It has been shown that applying the two critical reactances  $X_2$  and  $X_3$  maintains the symmetry on the 3-phase side. Consideration of total power and the total (VAR) leads to the power-factor on the 3-phase side.

The total power is obviously equal to the power of the 1-phase load, therefore :

$$P_t = V^2 \cdot (\cos \phi_1)^2 / R_1 \quad (30)$$

The VAR component of the 1-phase load is given by :-

$$(VAR)_1 = V^2 \cdot \sin \phi_1 \cdot \cos \phi_1 / R_1 \quad (31)$$

the P.F of the load being considered lagging, which represents the general case.

From equations (23) and (24), the values of  $(VAR)_2$  and  $(VAR)_3$  of the reactances  $X_2$  and  $X_3$ , respectively, are expressed as follows :-

$$(VAR)_2 = \frac{V^2}{\sqrt{3} \cdot R_1} \cdot \frac{\sqrt{3} \cdot \tan \phi_1 - 1}{1 + \tan^2 \phi_1} \quad (32)$$

and

$$(VAR)_3 = \frac{V^2}{\sqrt{3} \cdot R_1} \cdot \frac{\sqrt{3} \cdot \tan \phi_1 + 1}{1 + \tan^2 \phi_1} \quad (33)$$

The total reactive volt-ampere on the 3-phase side is obviously the sum of the values given in equations (31) to (33); therefore :-

$$(VAR)_1 = \frac{V^2}{R_1} \left[ \sin \varphi_1 \cdot \cos \varphi_1 + \frac{2 \cdot \tan \varphi_1}{1 + \tan^2 \varphi_1} \right] \quad (34)$$

which can be modified to :-

$$(VAR)_1 = \frac{V^2}{R_1} \cdot 3 \cdot \sin \varphi_1 \cdot \cos \varphi_1 \quad (35)$$

Dividing  $(P_s)$  by  $(VAR)_1$  given respectively by equations (30) and (35) gives the following expression :-

$$\tan \varphi_s = 3 \cdot \tan \varphi_1 \quad (36)$$

or the P.F of the 3-phase supply will be :-

$$\cos \varphi_s = \frac{\cos \varphi_1}{\sqrt{9 - 8 \cdot (\cos \varphi_1)^2}} \quad (37)$$

This last expression gives the supply PF in terms of 1-phase load P.F. Fig.(4) shows this relation for a lagging  $(\cos \varphi_1)$  in the range from zero to unity. It is obvious from this figure that the supply P.F is much smaller than that of the 1-phase load except when the latter is equal or near unity.

Since the apparent-power of the 1-phase load equals  $V^2 / |Z_1|$ , then the relations of  $(VAR)_2$  and  $(VAR)_3$  to 1-phase load  $(VA)_1$  are expressed by  $\beta_2$  and  $\beta_3$ , respectively as follows :-

$$\beta_2 = \frac{R_1}{(X_2 \cdot \cos \varphi_1)} \quad (38)$$

$$\beta_3 = \frac{R_1}{(X_3 \cdot \cos \varphi_1)} \quad (39)$$

In Fig.(5) are shown curves for  $\beta_2$  and  $\beta_3$  for 1-phase load lagging P.Fs in the range from zero to unity; values of  $X_2$  and  $X_3$  being taken from Table (A) given before.

The total  $(VAR)$  added externally to attain symmetry determines the extra cost required. For the load PF.  $\cos \varphi_1=1$ , this amounts to 1.16 times the apparent-power of the 1-phase load, while this rate rises to 2:1 in the case of pure inductive load. Conclusively, utilization of the static device formed of  $X_2$  and  $X_3$  is at its best with 1-phase load P.Fs equal to or near unity.

## (5) CONCLUSIONS

The main harmful effects of 1-phase loads fed from 3-phase supply have pointed out including injection of the alternating double frequency power-component into the supply, and causing it to be asymmetrical. Such asymmetry, leads to large transmission losses, and overheating as well as derating of 3-phase loads supplied from the same 3-phase network. Consequently, large 1-phase loads should, preferably, be reflected as 3-phase on the 3-phase side.

To this extent, this work introduces a static device composed of two reactances, which are to be connected in delta with the load across the 3-phase supply. It has proved that it is always possible, with any power-factor of the 1-phase load, to convert such load to be seen as 3-phase on the side of the 3-phase supply. Thus, the system behaves as a balanced 3-phase network with no extra energy loss due to the applied reactive-device. Since P.F. on the 3-phase side is expected to be less than that of the 1-phase load, except for unity power-factor, thus it is recommended that the device may be applied after improving the load P.F. to unity by an appropriate capacitor to be connected across the load terminals. The advantage of seeking unity P.F. is that no penalty, meaningly no (VAR), is to be added to the 3-phase system.

#### ACKNOWLEDGEMENT

The author is indebted to her colleagues at the " Electrical Power Department "of" Cairo University " for many helpful discussions.

#### REFERENCES

1. Merrill, F. : "The Challenge of Industrial Supplies". IEE News, July 1976.
2. Yacimini, R. and Chang, S. : "Noise and Vibration From Induction Machines Fed From Harmonic Sources". IEEE Trans. (En. Conversion), 1995.
3. Borrs, Hand Nittka, H. : "Developments of 3-Phase Cage Induction-Motors For High Ratings." AEG Mitteilungen, Berlin, 1984.
4. Emanuel, A.E. et al : "Survey of Harmonic Voltages and Currents at Customers' Buss" IEEE Trans (PWRD), Jan. 1993.
5. Leonhard, A. : "Messung, Überwachung und Regelung der Schiefast in Drehstromnetzen" ETZ-A, 1974.
6. Lyon, W.V. "Application of The method of Symmetrical Components" Book, McGraw-Hill Book Co., New York 1957.