

12-3-2020

## Evaluation of Displacement and Mixing Modes of Mechanical Ventilation Enclosure.

S. Elagouz

*Mechanical Power Engineering Department., Faculty of Engineering., Tanta University., Egypt.,  
elagouz2002@yahoo.com*

Follow this and additional works at: <https://mej.researchcommons.org/home>

---

### Recommended Citation

Elagouz, S. (2020) "Evaluation of Displacement and Mixing Modes of Mechanical Ventilation Enclosure.," *Mansoura Engineering Journal*: Vol. 33 : Iss. 2 , Article 9.  
Available at: <https://doi.org/10.21608/bfemu.2020.127223>

This Original Study is brought to you for free and open access by Mansoura Engineering Journal. It has been accepted for inclusion in Mansoura Engineering Journal by an authorized editor of Mansoura Engineering Journal. For more information, please contact [mej@mans.edu.eg](mailto:mej@mans.edu.eg).

## Evaluation of Displacement and Mixing Modes of Mechanical Ventilation Enclosure

تقييم نماذج التهوية بالإزاحة والخلط في حيز

S. A. El-Agouz

*Mechanical Power Engineering Department, Tanta University, Egypt*

ملخص البحث

يقدم هذا البحث دراسة عددية ومقارنة بين أداء حالات التهوية بالإزاحة والتهوية بالخلط تحت شروط حديه مختلفة. تظهر نتائج الدراسة على هيئة الراحة الحرارية وجودة الهواء الداخلي. تم دراسة أداء أربعة حالات بالتهوية بالإزاحة وحالتين بالتهوية بالخلط. تم دراسة تأثير كل من عدد رينولدز وعدد شميدت على أداء بالتهوية عن طريق الإزاحة والخلط. أظهرت النتائج في حالة التهوية بالخلط بأن أقل أداء ظهر في الحالة التي يكون الدخول والخروج من اعلي (السادسة) بينما أفضل أداء في الحالة التي يكون الدخول من اعلي والخروج من أسفل على الجانبين (الخامسة) عن طريق التهوية بالإزاحة الحالة التي يكون الدخول من أسفل على الجانبين والخروج من اعلي (الرابعة). أظهرت الدراسة أيضا أن كل من معدل انتقال الكتلة والطاقة وفعالية إزالة الحرارة والتلوث وكفاءة نظافة الهواء تتأثر بتغير كل من عدد رينولدز وعدد شميدت.

### Abstract

A numerical simulation using a computational fluid dynamics model is used to investigate and compare the performance of displacement and mixing ventilation modes under different boundary conditions. The companion paper reports the results in terms of the thermal comfort and the indoor air quality. Four modes (cases 1, 2, 3 and 4) of displacement ventilations and two modes (cases 5 and 6) of mixing ventilations are studied. The influence of Reynolds and Schmidt numbers on the performance of displacement and mixing ventilations are presented. The results show that the lower performance in case 6 for mixing ventilation while the higher performance in case 5 for mixing ventilation and case 4 for displacement ventilation. The heat and mass transfer rates, the heat and contaminant removal effectiveness and the air clearing efficiency are influenced by the change of the Reynolds and Schmidt numbers.

*Keywords:* CFD; Mixed convection; Displacement and mixing ventilation; heat/Contaminant sources

Corresponding author: Tel.:+20506810503; Fax: +2040 3315861

*E-mail address:* elagouz2002@yahoo.com

Accepted June 30, 2008

## 1. Introduction

Prediction of indoor environment is very important for analysis of energy consumption and indoor air quality. It is well known that there exist temperature variations in different zones of a room. The temperature of the "occupied zone" where the occupants stay is usually different from that of the "discharge zone" of the conditioning air. In room air distribution, there are usually two methods of supplying the air: either mixing ventilation or displacement ventilation. In mixing ventilation, air is normally supplied at high level over the ceiling which is then deflected down into the occupied zone by the opposite walls thus causing a mixing of the air jet with room air. In displacement ventilation, the air is supplied at low level, usually over the floor, and then rises up due to buoyancy before it is extracted at high level. In displacement ventilation, both natural and forced convection must be taken into account. The interaction between the two convective flows is important to achieve the effectiveness of ventilation. Visualizing the processes may provide a new means to understand the philosophy.

The air movement inside the room also affects the performance of displacement ventilation system. Melikov et al. [1] studied the air flow characteristics in the occupied zone. Flow visualization indicated the convective flow generated above the heat sources and the development of the stratified layer. Xing et al. [2], Park and Holland [3], Wyon and Sandberg [4], Gan [5 and 6], Lin et al. [7], Deng et al. [8], Chen et al. [9], and Nielsen [10] presented a study of the air distribution or air quality or thermal comfort in the breathing zone in a room or enclosure with displacement ventilation. Lian [11] investigated the effect of the type of

outlet, distance between the occupant and outlet, velocity and temperature of supply air, and the type of outlet on displacement ventilation. The results show that the main influence on the thermal comfort was the distance between the occupant and the supply. Shaun and Andrew [12] investigate the steady state natural ventilation of a room heated at the base and consisting of two vents at different levels. These findings suggest how the appropriate ventilation strategy for a room can be varied depending on the exterior temperature, with mixing ventilation more suitable for winter conditions and displacement ventilation for warmer external temperatures.

Awbi [13] compared the effectiveness of mixing and displacement ventilation in terms of heat and contaminant removal. The CFD simulations and the measurements suggest that displacement ventilation was more energy efficient than a mixing system. Deng and Tang [14] investigated two-dimensional, steady and laminar for the displacement and mixed ventilation models. The results and comparisons showed that the displacement ventilation guarantees a high indoor air quality (IAQ) and was therefore a desired air-conditioning system. Linden et al. [15] studied the natural ventilation inside a room by using the "emptying filling boxes method" to investigate the plume spreading in a density stratified flowing fluid (brine). They compared the flow pattern of mixing ventilation and displacement ventilation under various loading conditions. They also proposed a formula to estimate the height of the displacement zone.

The goal of the present work was to study in detail and compare the performance of displacement and mixing ventilation modes. Four modes (cases 1,

2, 3 and 4) of displacement ventilations and two modes (cases 5 and 6) of mixing ventilations are studied. The influence of Reynolds and Schmidt numbers on the performance of displacement and mixing ventilations models are presented. The companion paper will report the results in terms of the thermal comfort and the indoor air quality. The thermal comfort parameters are expressed by temperature distribution and ventilation effectiveness for heat removal ( $\epsilon_h$ ). The indoor air quality is determined by investigating the contaminant distribution, ventilation effectiveness for the contaminant removal ( $\epsilon_c$ ), and the air cleaning efficiency ( $\xi$ ).

## 2. Physical description of model

The physical model of displacement and mixing ventilation models under consideration here is schematically shown in Fig. (1). It is a two-dimensional ventilated square section room, with sides of length  $L$ . A heat source (H.S.) of size  $L_{hs}$  and high temperature  $t_h$ , located at the center of the floor wall, and two contaminant sources (C. S.) of size  $L_{cs}$  and high concentration  $c_h$  each located at the center of the right and left walls. The fresh cold air ( $u_{in}$ ,  $t_{in}$ ,  $c_{in}$ ) is supplied from the inlet and the polluted hot air exhausted from the outlet at different locating walls as shown in the figure. The inlet and outlet are of the same size,  $h$ . Other parts of the room are all considered adiabatic. The different locations of the air inlets and outlets for displacement ventilation models are shown in Fig. (1a, 1b, 1c, 1d.) and for mixing ventilation models in Fig. (1e, and 1f).

## 3. Governing equations

The analysis is based on the two-dimensional steady continuity, momentum, concentration and energy equations in dimensionless form. The

flow is steady, incompressible, and laminar. The air and the contaminant gases are perfectly mixed. All the thermo-physical of the fluid properties are constant, except that of the density in the buoyancy term of the momentum equation following the Boussinesq approximation.

Considering the above assumptions, the governing equations are non-dimensionalized using scales  $L$ ,  $u_{in}$ ,  $\Delta t = (t_h - t_{in})$ , and  $\Delta c = (c_h - c_{in})$  for length, velocity, temperature, and concentration respectively. Accordingly the dimensionless variables are  $(X, Y) = (x, y)/L$ ,  $(U, V) = (u, v)/u_{in}$ ,  $P = p / \rho u_{in}^2$ ,  $\theta = (t - t_{in})/\Delta t$ ,  $C = (c - c_{in})/\Delta c$  and dimensionless parameters are defined as  $Pr = \nu / \alpha$ ,  $Gr = g\beta_t \Delta t L^3 / \nu^2$ ,  $Re = u_{in} L / \nu$ ,  $Sc = \nu / D$ ,  $Br = \beta_c \Delta c / \beta_t \Delta t$

The governing equations for airflow in a ventilated room include continuity, momentum, energy and concentration, can be written in the general form as the following:

$$\frac{\partial}{\partial X}(\beta \Phi U) + \frac{\partial}{\partial Y}(\beta \Phi V) = \frac{\partial}{\partial X}(\Gamma \frac{\partial \Phi}{\partial X}) + \frac{\partial}{\partial Y}(\Gamma \frac{\partial \Phi}{\partial Y}) + (S_u + S_p \Phi) \quad (1)$$

The  $\Phi$ ,  $\beta$ ,  $\Gamma$ ,  $S_u$  and  $S_p$  used in Eq. (1) are given in Table 1. The boundary conditions for  $U$ ,  $V$ ,  $\theta$  and  $C$  are given as follows:

Inlet:  $U=1, V=0, \theta=0$  and  $C=0$   
 Outlet:  $\partial U / \partial n = 0$  and  $\partial \theta / \partial n = 0$ ,  $\partial C / \partial n = 0$   
 Walls:  $U=V=0, \theta=1$  for the heat source and  $\partial \theta / \partial n = 0$  elsewhere,  $C=1$  for contaminant source and  $\partial C / \partial n = 0$  elsewhere.

The local Nusselt number ( $Nu$ ) and Sherwood number have been evaluated

$$\text{Nu}(X) = -(\partial\theta/\partial Y)|_{Y=0} \quad \text{and} \\ \text{Sh}(Y) = (\partial C/\partial X)|_{X=0} + (\partial C/\partial X)|_{X=1}$$

The average Nusselt and Sherwood numbers describe the heat and mass transfer rates on the surfaces of heat and contaminant sources are expressed as follows

$$\text{Nu}_{in} = \frac{1}{\epsilon_{hs}} \left[ \int_{(1-\epsilon_{hs})/2}^{(1+\epsilon_{hs})/2} -(\partial\theta/\partial Y) dX \right]_{Y=0} \quad (2)$$

$$\text{Sh}_{in} = \frac{1}{\epsilon_{cs}} \left[ \int_{(1-\epsilon_{cs})/2}^{(1+\epsilon_{cs})/2} -(\partial C/\partial X) dY \right]_{X=0} \\ + \frac{1}{\epsilon_{cs}} \left[ \int_{(1-\epsilon_{cs})/2}^{(1+\epsilon_{cs})/2} -(\partial C/\partial X) dY \right]_{X=1} \quad (3)$$

Since  $\epsilon_{hs}$  and  $\epsilon_{cs}$  is set equal to 0.5 for the study

The ventilation effectiveness for heat removal ( $\epsilon_h$ ) reflects the ability of the ventilation system to remove heat and it is defined by:

$$\epsilon_h = \frac{\theta_{out} - \theta_{in}}{\theta_m - \theta_{in}} \quad (4)$$

The Ventilation effectiveness for contaminant removal ( $\epsilon_c$ ) is a measure of how effective the ventilation system is in removing internally produced contamination. It is defined by:

$$\epsilon_c = \frac{C_{out} - C_{in}}{C_m - C_{in}} \quad (5)$$

where  $\theta_{in}$  and  $C_{in}$  are the dimensionless temperature and contaminant concentration of inlet air, (typically zero), respectively;  $\theta_{out}$  and  $C_{out}$  are the dimensionless temperature and contaminant concentration of outlet air, respectively;  $\theta_m$  and  $C_m$  are the mean values for dimensionless temperature and contaminant concentration of air in the occupied zone, respectively.

ASHRAE [16] recommends using the air cleaning efficiency,  $\xi$ , to evaluate

such configurations, where  $\xi$  is calculated from:

$$\xi = 1 - C_{out} \quad (6)$$

#### 4. Numerical procedure

The present two-dimensional problem has been treated numerically using the control volume finite difference method described by Patankar [17]. The computational domain in two dimensions has been discretised using control volumes of uniform size. The discretisation equations have been obtained by applying conservation laws over a finite size control volume surrounding the grid node and integrating over the control volume, Versteeg and Malalasekera [18]. Convection-diffusion terms have been treated by the upwind scheme and diffusion and source terms have been treated by the central differencing scheme. Resulting algebraic equations have been solved simultaneously using the Gauss-elimination procedure until convergence has been achieved. The convergence of results were assumed to be reached when the maximum relative changes of all velocity, temperature, stream function, concentration, and vorticity values between the consecutive iterations were less than  $10^{-6}$ . The above mentioned numerical method has been implemented in a self-written FORTRAN computer code that has been developed to simulate systems of coupled non-linear partial differential equations in two dimensions. In order to obtain a numerical solution that was not affected by the grid size, different grid sizes:  $40 \times 40$ ,  $65 \times 65$ ,  $81 \times 81$ ,  $97 \times 97$  and  $104 \times 104$  for the same problem were tested. Considering the accuracy requirement, the grid size used in this study was  $97 \times 97$ .

#### 5. Model validation

To validate the mathematical and numerical model, the displacement mode

for square enclosure as shown in Fig. 1a is simulated and compared with measured data from M. Cehlin et al. [19] and also compared with result from the commercial finite volumes code Fluent 6.0.

The experimental data obtained by thermal images taken by infrared thermography while numerical result obtained by the commercial finite volumes code Fluent 6.0 as shown in Fig. 2. Convection studied for  $Re = 500$ ,  $Gr = 10^6$ ,  $Pr = Sc = 0.7$ ,  $Br = 1$ ,  $\epsilon_r = 1$ ,  $\epsilon_{hs} = \epsilon_{cs} = 0.5$ , and  $\epsilon_{in} = \epsilon_{out} = 1/8$ . The comparison of simulated isothermal line of present work with measured data by M. Cehlin et al. [20] and from code Fluent 6.0 is shown in Fig. 2, which indicates a fairly good agreement. Thus the mathematical model is validated and may be adopted to perform further numerical study. Also, the mathematical and numerical model is validated by El-Agouz [20].

## 6. Results and discussions

In the present study, the aspect ratios of the ventilated room, the heat source, the contaminant source, the inlet air and outlet air of what are kept constant as  $\epsilon_r = 1$ ,  $\epsilon_{hs} = \epsilon_{cs} = 0.5$ ,  $\epsilon_{in} = \epsilon_{out} = 1/8$ . The buoyancy ratio, Prandtl number and Grashof number are held fixed at  $Br = 1$ ,  $Pr = 0.7$  and  $Gr = 10^6$ . The effect of the Reynolds and Schmidt numbers on the performance of the different models for displacement and mixing ventilation is studied. During the study, the Schmidt number varied from 0.2 to 2.4 and Reynolds number varied from 50 to 1500.

Figure 3 shows the evolution of isothermal contours with  $Re$  of different cases at  $Sc = 0.7$ . With the increase of the Reynolds number for different cases, the isothermal line decreases in occupied zone for all cases. The figure shows that

the lower temperature is found in case 5 and the higher in Case 6 for the mixing ventilation. On the other hand, for the displacement ventilation the change between cases is small. These observations indicate that the decrease of the temperature level the accumulated energy is saved more.

Figure 4 shows the evolution of contaminant contours with  $Sc$  of different cases at  $Re = 500$ . With the increase of the Schmidt number, the contaminant contours decreases in occupied zone for all cases. The figure shows that the lower contaminant concentration is found in case 5 and the higher in Case 6 for the mixing ventilation. On the other hand, for the displacement ventilation the change between cases is small. These observations indicate that the decrease of the contaminant contours level the indoor environmental conditions is improved.

The variation of average Nusselt number is plotted in Fig. 5 against Reynolds and Schmidt numbers for different cases. It shows the non-linear variation between Reynolds and average Nusselt number for given Schmidt number. At  $Re = 1500$ , the average Nusselt number was about 21.92, 20.97, 21.46, 23.27, 24.69, and 5.95 for the cases 1 to 6 respectively. Mixing ventilation (case 6) is associated with higher average Nusselt number than displacement ventilation while, mixing ventilation (case 5) is associated with lower average Nusselt number than displacement ventilation. The figure shows that the best  $Nu_m$  is found in case 5 for the mixing ventilation and case 4 for the displacement ventilation.

The average Sherwood number,  $Sh_m$ , for different cases as function of Reynolds and Schmidt numbers is displayed in Fig. 6. The average Sherwood number increases with increasing the  $Re$  and  $Sc$  due to the

forced convection fully dominates the airflow structure. At  $Re = 1500$ , the average Sherwood number was about 21.35, 19.32, 17.74, 18.75, 19.69, and 14.53 for the cases 1 to 6 respectively. It is observed that, the mass transfer rate is highly influenced by the different cases of ventilation.

Fig. 7 gives the comparison of Mean temperature of different cases at different Reynolds and Schmidt numbers.  $\theta_m$  in the occupied zone decreases with increasing  $Re$  due to the enhanced ventilation while, it is constant with increasing  $Sc$ . At  $Re = 1500$ , the Mean temperature was about 0.069, 0.098, 0.085, 0.026, 0.007, and 0.163 for the cases 1 to 6 respectively. Mixing ventilation (case 6) is associated with higher mean temperature than displacement ventilation while, mixing ventilation (case 5) is associated with lower mean temperature than displacement ventilation. The figure shows that the best  $\theta_m$  is found in case 5 for the mixing ventilation and case 4 for the displacement ventilation, Case 6 has the highest mean temperature for the studied ranges of  $Re$  and  $Sc$ .

Fig. 8 gives the comparison of Mean contaminant concentration of different cases at different Reynolds and Schmidt numbers.  $C_m$  in the occupied zone decreases with increasing  $Re$  and  $Sc$  due to the enhanced ventilation. Mixing ventilation (case 6) is associated with higher mean contaminant concentration about 77% than other cases and the other cases have little difference between them. The figure shows that Case 6 has the highest mean contaminant concentration for all values of  $Re$  and  $Sc$ .

The variation of ventilation effectiveness for heat removal ( $\epsilon_h$ ) is plotted in Fig. 9 as a function of Reynolds and Schmidt numbers for different cases. The figure clearly shows

that  $\epsilon_h$  decreases with increasing Reynolds and Schmidt numbers for all cases except in case 5 increases. At  $Re = 1500$ , the ventilation effectiveness for heat removal was about 0.159, 0.195, 0.496, 1.217, 2.85, and 0.057 for the cases 1 to 6 respectively. The figure shows that the best  $\epsilon_h$  is found in case 5 for the mixing ventilation and case 4 for the displacement one.

The variation of ventilation effectiveness for contaminant removal is plotted in Fig. 10 as a function of Reynolds and Schmidt numbers for different cases. The figure clearly shows that the values of the ventilation effectiveness for contaminant removal curves are little affected by Reynolds and Schmidt numbers for all cases. At  $Re = 1500$ , the ventilation effectiveness for contaminant removal was about 2.87, 1.53, 4.968, 5.83, 4.51, and 1.12 for the cases 1 to 6 respectively. The figure shows that the best  $\epsilon_c$  is found in case 4 for improved the air quality and the lower in case 6 for all values of  $Re$  and  $Sc$ .

Fig. 11 gives the comparison of air cleaning efficiency of different cases at different Reynolds and Schmidt numbers. The figure shows that as  $Re$  and  $Sc$  are increased, the air cleaning efficiency is increased due to the enhanced ventilation. In addition, the best  $\epsilon_c$  is found in case 2 and the lower in case 4 for  $Re$  and  $Sc$ .

## 7 Conclusions

In this paper, numerical simulation is carried out to study the effects of different Reynolds and Schmidt numbers on performance of different displacement and mixing ventilation models. The enclosure heated at the bottom wall and two contaminant sources at right and left walls. The conclusions may be drawn as follows:

- The lower performance is found in case 6 for mixing ventilation while the higher performance in case 5 for mixing ventilation and case 4 for displacement ventilation.
- The heat and mass transfer rates, the heat and contaminant removal effectiveness and the air clearing efficiency influenced by the change of the Reynolds and Schmidt numbers.
- Mixing ventilation (case 6) is associated with higher mean contaminant concentration about 77% than other cases.
- Results for different cases show that the nearer the outlet is from the heat and contaminant sources, the more effective it is to vent heat and contaminant generated by the sources for displacement and mixing ventilation

### Nomenclature

Br	buoyancy ratio
c, C	dimension and dimensionless concentrations
D	mass diffusivity
g	gravity acceleration
Gr	Grashof number
h	sizes of inlet or outlet
k	thermal conductivity (W/m. K)
L	length or length of the room
Nu <sub>m</sub>	average Nusselt number
Pr	Prandtl number
Re	Reynolds number
Sc	Schmidt number
Sh <sub>m</sub>	average Sherwood number
t	temperature
U, V	dimensionless velocities in X and Y directions
u, v	velocity components in x and y directions
x, y	Cartesian coordinates
X, Y	dimensionless Cartesian coordinates

### Greek symbols

$\beta$	thermal expansion coefficient
$\rho$	density
$\epsilon_h$	ventilation effectiveness for the heat
$\epsilon_c$	ventilation effectiveness for contaminant
$\alpha$	thermal diffusivity
$\nu$	kinematic viscosity
$\phi$	general variable
$\omega$	dimensionless vorticity
$\theta$	dimensionless temperature
$\Psi'$	dimensionless stream function
$\epsilon$	aspect ratio
$\xi$	air cleaning efficiency

### Subscripts

c	concentration
cs	contaminant source
h	high
hs	heat source
i	local
in	inlet
m	mean
out	outlet
r	room
t	thermal

### References

- [1] A.K. Melikov, G. Langkilde, B. Derbiszewski, Airflow characteristics in the occupied zone of rooms with displacement ventilation, ASHRAE Transactions 96 (Part 1) (1990) 1050–1057.
- [2] H. Xing, A. Hatton, H.B. Awbi, A study of the air quality in the breathing zone in a room with displacement ventilation, Building and Environment 36 (2001) 809–820
- [3] H.-J. Park, D. Holland, The effect of location of a convective heat source on displacement ventilation: CFD study, Building and Environment 36 (2001) 883–889



- [4] DP. Wyon, MH. Sandberg, Thermal manikin prediction of discomfort due to displacement ventilation, *ASHRAE Transactions* 96 (1) (1990)
- [5] G. Gan, Evaluation of room air distribution systems using computational fluid dynamics, *Energy and Buildings* 23 (1995) 83-93
- [6] G. Gan, Numerical investigation of local discomfort in offices with displacement ventilation, *Fuel and Energy* 37 (2) (1996) 82-15
- [7] Z. Lin, T.T. Chow, C.F. Tsang, K.F. Fong, L.S. Chan, CFD study on effect of the air supply location on the performance of the displacement ventilation system, *Building and Environment* 40 (8) (2005) 1051-1067
- [8] Q.-H. Deng, J. Zhou, C. Mei, Y.-M. Shen, Fluid, heat and contaminant transport structures of laminar double-diffusive mixed convection in a two-dimensional ventilated enclosure, *International Journal of Heat and Mass Transfer* 47 (2004) 5257-5269
- [9] Q. Chen, P. Suter, A. Moser, Influence of air supply parameters on indoor air diffusion, *Building and Environment* 26 (4) (1991) 417-431
- [10] P. V. Nielsen, Velocity distribution in a room ventilated by displacement ventilation and wall-mounted air terminal devices, *Energy and Buildings* 31 (2000) 179-187
- [11] Z. Lian, Experimental study factors that affect thermal comfort in an upward-displacement air-conditioned room, *HVAC and R. Research* 8 (2) (2002) 191-200
- [12] D. F. Shaun, W. W. Andrew, On the transition from displacement to mixing ventilation with a localized heat source, *Building and Environment* 42 (2007) 2210-2217
- [13] H. B. Awbi, Energy efficient room air distribution, *Renewable Energy* 15 (1998) 293-299
- [14] Q.-H. Deng, G.-F. Tang, Numerical visualization of mass and heat transport for mixed convective heat transfer by streamline and heatline, *International Journal of Heat and Mass Transfer* 45 (2002) 2387-2396.
- [15] P.F. Linden, G.F. Lane-Serff, D.A. Smeed, Emptying filling boxes: the fluid mechanics of natural ventilation, *Journal of Fluid Mechanics* 212 (1990) 309-335.
- [16] ASHRAE, Handbook: HVAC Systems & Equipment (2000), Fundamentals (2001), Refrigeration (2002) and HVAC Applications (2003).
- [17] S. V Patankar, Numerical heat transfer and fluid flow, Hemisphere publishing company, New York, 1980
- [18] H. K Versteeg, W. Malalasekera, An introduction to computational fluid dynamics the finite volume method, John Wiley & Sons Inc., New York, 1995.
- [19] M. Cehlin, B. Moshfegh, H. Stymne, Mapping of indoor climate parameters in Volvo, Eskilstuna, Working Paper no. 10, University of Gävle, 2000 (in Swedish).
- [20] S.A. El-Agouz, The effect of internal heat source and opening locations on environmental natural ventilation, *Energy and Buildings* 40 (2008) 409-418

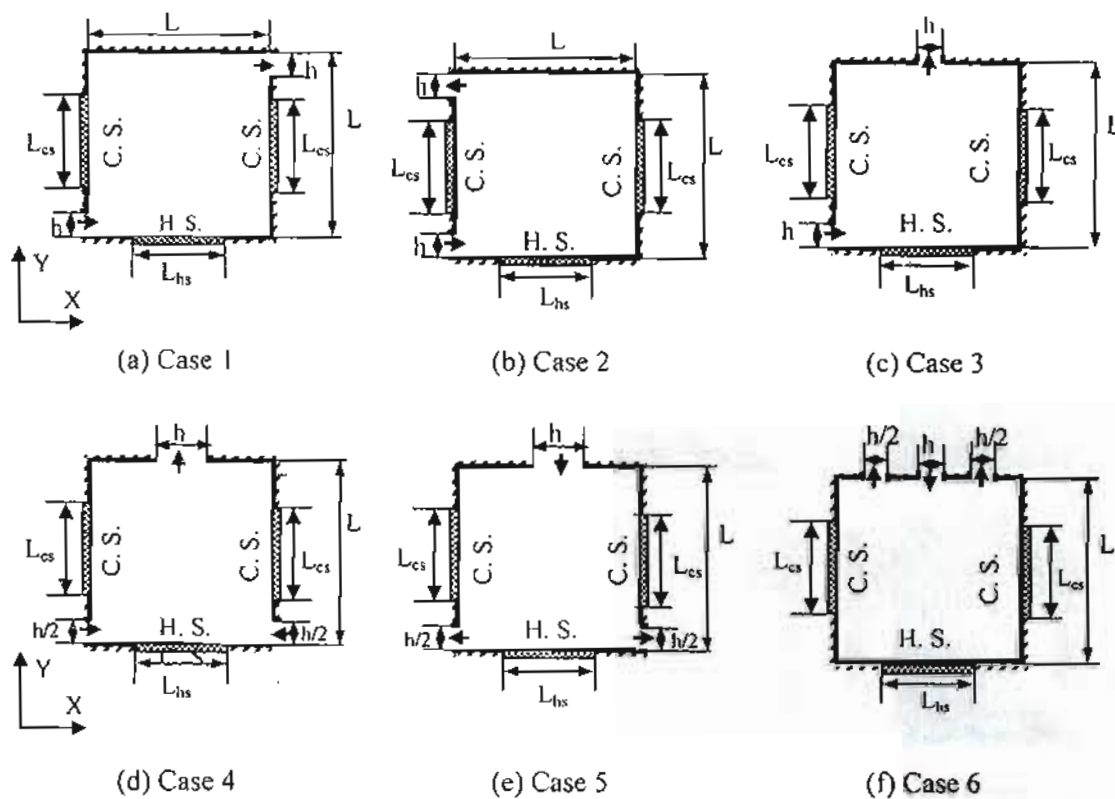



Fig. 1 Schematic diagram of physical configuration of considered displacement and mixing models



M. Cehlin et al. [19]



Fluent 6.2

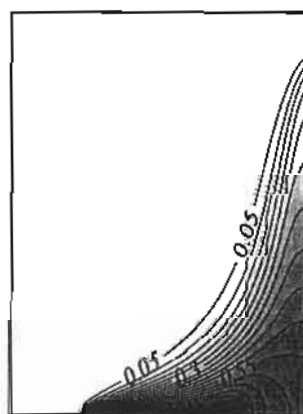

Present work

Fig. 2. Results comparison between the present work, M. Cehlin et al. [19] and Fluent 6.2 for isothermal lines

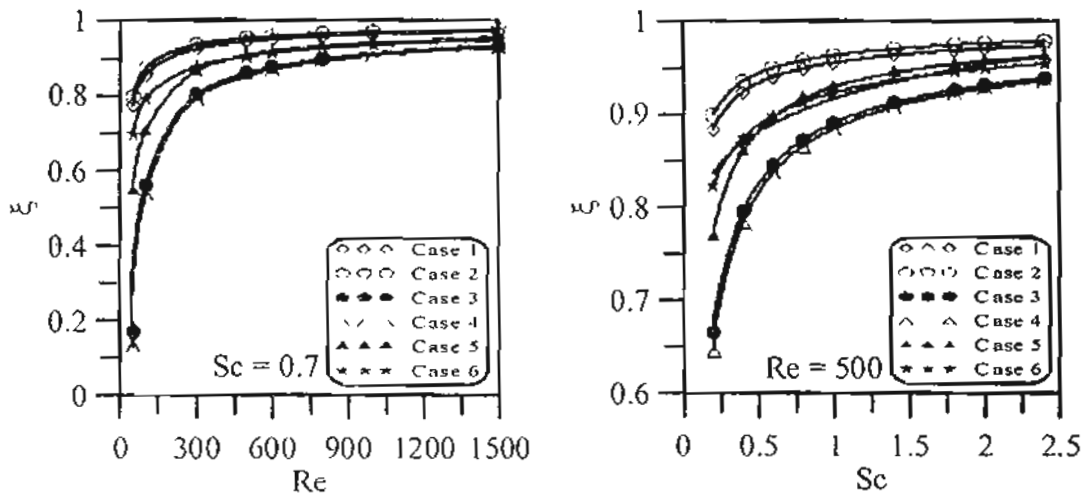


Fig. 11 Air cleaning efficiency versus Reynolds and Schmidt numbers for different cases

Table 1 The  $\Phi$ ,  $\beta$ ,  $\Gamma$ ,  $S_u$  and  $S_p$  used in Eq. (1).

$\Phi$	$\beta$	$\Gamma$	$S_u$	$S_p$
U	0	0	$\partial\psi/\partial Y$	1
V	0	0	$\partial\psi/\partial X$	-1
$\omega$	1	$1/Re$	$Gr/Re^2[\partial\theta/\partial X + Br \partial C/\partial X]$	0
$\psi$	0	1	$\omega_p$	0
$\theta$	1	$1/Re Pr$	0	0
C	1	$1/Re Sc$	0	0